

ANCHORING & DOWELING

A Meridian Adhesives Group Company

ULTRABOND **HS-1CC**

High-Strength Anchoring Epoxy







COMPATIBLE



WIND LOAD

STATE DOT





Product Description

ULTRABOND® HS-1CC is a code compliant, two-component, 1:1 mix ratio by volume, high performance epoxy anchoring system approved for use in cartridges and in bulk with threaded rod and reinforcing bar for cracked and uncracked concrete conditions, and internally threaded inserts in uncracked concrete in accordance with ACI 355.4 and ICC-ES AC308. It has an extended application temperature range between 43 °F and 110 °F (6 °C and 43 °C) for structural applications per ICC-ES ESR-4094 and between 38 °F and 125 °F (3 °C and 52 °C) for transportation infrastructure applications to AASHTO M235 & ASTM C881.

General Uses & Applications

- Anchoring threaded rod and reinforcing bar (rebar) into cracked or uncracked concrete using hammer drill or uncracked concrete using core drill
- Suitable for dry, water saturated, water-filled & submerged (underwater) conditions using threaded rod or rebar
- Vertical down, horizontal, upwardly inclined and overhead installations

Advantages & Features

- ICC-ES ESR-4094 evaluation report for cracked and uncracked concrete
- Building code compliant in cartridge and bulk dispensing systems, IBC/IRC: 2021, 2018, 2015, 2012 & 2009
- City of Los Angeles Code (LABC/LARC) compliant: 2017
- Florida Building Code (FBC) compliant: 2017
- Abu Dhabi International Building Code (ADIBC) compliant: 2013
- ICC-ES AC308 and ACI 355.4 assessed for resisting short term loading conditions up to 205 °F (96 °C)
- ULCertified-DrinkingWaterSystemComponentstoNSF/A:20NSI 61 & Lead Free to NSF/ANSI 372
- ULTRABOND HS-1CC contributes toward satisfying credits for Indoor Environmental Quality for Low-Emitting Materials under
- Suitable for core drilled installations in dry or water saturated concrete
- Multiple anchor types: threaded rod, rebar & internally threaded inserts

STANDARDS & APPROVALS

CODE COMPLIANT: ICC-ES ESR-4094

IBC/IRC 2021, 2018, 2015, 2012, & 2009

City of Los Angeles 2017 Florida Building Code 2017 & 2014 Abu Dhabi International Building Code 2013 Drinking Water System Components NSF/ANSI 61 & 372

ASTM C881-20 / AASHTO M235 Type I, II, IV & V Grade 3 Class A, B & C **Department of Transportation (DOT) Approved Nationwide**

- OSHA Table 1 compliant drilling/cleaning method using Milwaukee Tool hollow vacuum bit system
- Qualified for Seismic Design Categories A through F
- Nationwide DOT approved or pending
- Made in the USA with global materials
- Buy American compliant per CFR 49 Section 50101
- Acceptable for use in USDA inspected facilities
- Compatibe with Adhesives Technology Corp. (ATC) free Pro Anchor Design software

Availability: ATC products are available online and through select distributors serving all your construction needs. Please contact ATC for a distributor near you or visit www.atcepoxy.com for online purchasing options or to search for a distributor by zip code.

Color & Ratio: Part A (Resin) White: Part B (Hardener) Dark Gray, Mixed Ratio: 1:1 by volume, Mixed Color - Gray

Storage & Shelf Life: 24 months when stored in unopened containers in dry and dark conditions. Store between 40 °F (4 °C) and 95 °F (35 °C).

Installation & Estimation: Manufacturer's Printed Installation Instructions (MPII) / Instruction Card (IC) are available within this Technical Data Sheet (TDS). Due to occasional updates and revisions, always verify and use the most current instructions. In order to achieve maximum results, proper installation is imperative. An estimating guide for product usage may be found at www.atcepoxy.com/estimation.

Clean-Up: Always wear appropriate personal protective equipment such as safety glasses and gloves. Clean uncured materials from tools and equipment using a mild solvent, such as CRACKBOND® INDUSTRIAL CITRUS CLEANER from Adhesives Technology Corp. Cured material may only be removed mechanically using a sander or grinder. Collect with absorbent material. Flush area with water. Dispose of in accordance with local, state and federal disposal regulations.

Limitations & Warnings:

- Do not thin with solvents, as this will prevent cure
- For anchoring applications, concrete should be a minimum of 21 days old prior to anchor installation per ACI 355.4
- Bulk versions of ULTRABOND HS-1CC cannot be mixed by hand and must only be mixed using an automatic proportioning plural component pump (see MPII / IC for details)
- · Always consult with the Engineer of Record, or a design professional, prior to use to ensure product applicability

Safety: Please refer to the Safety Data Sheet (SDS) for ULTRABOND HS-1CC. Call ATC for more information at 1-800-892-1880.

Specification: Anchoring Adhesive must meet the requirements of ICC-ES AC308, ACI 355.4. Adhesive must have a compressive yield strength of 14,480 psi (99.8 MPa) at 75 °F (24 °C) after a 7 day cure per ASTM D695. Adhesive shall be ULTRABOND HS-1CC from Adhesives Technology Corp., Pompano Beach, Florida. Anchors shall be installed per the MPII / IC for ULTRABOND HS-1CC anchoring



Ordering Information

TABLE 1: ULTRABOND HS-1CC Adhesive Packaging, Dispensing Tools and Mixing Nozzles

Package Size	8.6 fl. oz. (254 ml)	21.2 fl. oz. (627 ml)	53 fl. oz. (1.6 L)	10 Gallon	(38 L) Kit ²
r ackage Size	Cartridge ¹	Cartridge ¹	Cartridge ¹	Resin	Hardener
Part #	A9-HS1CC	A22-HS1CC	A53-HS1CC	B5G-HS1CC-A	B5G-HS1CC-B
Recommended Mixing Nozzle		T12 or T34HF		Т3-	4HF
Manual Dispensing Tool	TM9HD	TM22HD		N/A	
Pneumatic Dispensing Tool	N/A	TA22HD-A	TA53HD-A	Pump	
Battery Tool	IN/A	TB22HD-A		N/A	
Case Qty.	1	2	6	N	I/A
Pallet Qty.	1,116	432	252	12	kits
SDS Brush Adaptor			BR-SDS		
Brush Extension			BR-EXT		
Nozzle Extension Tubing			TUBE916-E	XT	
Retention Wedge			WEDGE		

1. Each cartridge is packaged with one mixing nozzle.

TB22HD-A

2. ATC recommends AST bulk pump model number RMP 6624-1717.

TA53HD-A



T34HF



Ordering Information

In order to reduce the risks to respirable crystalline silica, ULTRABOND HS-1CC has been tested and approved for use in conjunction with Milwaukee Tool's OSHA compliant, commercially available dust extraction products for use in combination with ULTRABOND HS-1CC installations in dry and water saturated (damp) concrete (see Table 2 for details). When used in accordance with the manufacturer's instructions, and in conjunction with ULTRABOND HS-1CC, these Vacuum Drill Bits along with the Dust Extractor with HEPA filter as specified by Milwaukee Tool, can completely replace the traditional blowbrush-blow cleaning method used to install threaded rod (see Installation Instructions (MPII) for more detail). Important: Prior to injecting the adhesive, the hole must always be clean, either by using self-cleaning vacuum bits or by using the blow-brush-blow cleaning method with a traditional hammer drill bit and dust shroud. Only vacuuming out a hole drilled with a standard masonry bit is NOT acceptable and will yield lower performance than published for the anchoring/doweling adhesive. For more information, see Respirable Crystalline Silica White Paper at www.atcepoxy.com/resources.



Milwaukee Tool Dust Extraction System

TABLE 2: Milwaukee Vacuum Drill Components¹

Part #	Drill Type	Drill Bit Size in.	Overall Length in.	Useable Length in.
48-20-2102		7/16	13	7 7/8
48-20-2106		1/2	13	7 7/8
48-20-2110	SDS+	9/16	14	9 1/2
48-20-2114		5/8	14	9 1/2
48-20-2118		3/4	14	9 1/2
48-20-2152		5/8	23	15 3/4
48-20-2156		3/4	23	15 3/4
48-20-2160	SDS-Max	7/8	23	15 3/4
48-20-2164	3D3-IVIAX	1	25	17 1/2
48-20-2168		1-1/8	35	27
48-20-2172		1-3/8	35	27
8960-20		8 Gallon Dust E	xtractor Vacuum	

^{1.} Vacuum drill accessories available from Milwaukee distributors nationwide.



Material Specifications

TABLE 3: ULTRABOND HS-1CC performance to ASTM C881-20^{1,2,3}

					Sample C	onditioning Te	mperature		
Property	Cure	ASTM	Units	Class A	Class B	Optional	Optional	Class C	
rioperty	Time	Standard	Office	38 °F (3 °C)	50 °F (10 °C) 75 °F (24 °C) 110 °F (43 °C) 13 10 2 ⁴ Non-sag 13,280 14,480 14,500 (91.6) (91.6) (99.8) (100.0) 0 506,100 475,900 599,600	125 °F (52 °C)			
Gel Time - 60 Gram Mass		C881	min	14	13	10	2 ⁴	2 ⁴	
Consistency or Viscosity		C881				Non-sag			
Compressive Yield Strength	7 day	D695	psi (MPa)	12,980 (89.5)	′	· '	· '	13,430 (92.6)	
Compressive Modulus	r day	D093	psi (MPa)	534,900 (3,688)	· · · · · · · · · · · · · · · · · · ·	l '	· '	585,600 (4,038)	
Bond Strength	2 day		psi (MPa)	2,700 (18.6)	′	,	· '	2,050 (14.1)	
Hardened to Hardened Concrete	14 day	C882	psi (MPa)	2,860 (19.7)	<i>'</i>	· '	l '	2,080 (14.3)	
Bond Strength Fresh to Hardened Concrete	14 day		psi (MPa)			,	Optional Class 110 °F 125 (43 °C) (52 ° 2 ⁴ 2 ⁴ 14,500 13,4 (100.0) (92.0 599,600 585,6 (4,134) (4,03 3,150 2,05 (21.7) (14. 3,050 2,08		
Tensile Strength ⁵		D638	psi (MPa)			-,			
Tensile Elongation ⁵	7 day	D036	%			1.0			
Heat Deflection Temp.		D648	°F (°C)						
Dielectric Volume Resistivity		D3755	Pass/Fail			Pass			
Water Absorption	24 hr	D570	%	% 0.02					
Linear Coefficient of Shrinkage		D2566	%			0.0003			

- 1. Product testing results based on representative lot(s). Average results will vary according to the tolerances of the given property.
- 2. Full cure time is listed above to obtain the given properties for each product characteristic.
- 3. Results may vary due to environmental factors such as temperature, moisture and type of substrate.
- 4. Gel time may be lower than the minimum required for ASTM C881.
- 5. Optional testing for ASTM C881 Grade 3.

TABLE 4: ULTRABOND HS-1CC NSF/ANSI CERTIFICATIONS¹

ANSI Certification	Description	Application	Water Contact Temperature	Anchor Sizes Installed in Concrete
NSF 61	Drinking Water System Componenets - Health Effects	Joining and Sealing	Commercial Hot 180 ± 4 °F	Threaded Rod and Rebar
NSF 372 ²	Lead Free, U.S. Safe Drinking Water Act	Materials	(82 ± 2 °C)	≤ 1 1/4 in. Diameter

^{1.} ULTRABOND HS-1CC is certified as a joing and sealing material. Mix Ratio: Part A (Resin): Part B (Hardener) = 1:1 by volume. Application method: Dispensing mixing nozzle system. Final Cure Time: 24 hours at 75 °F (24 °C).

TABLE 5: ULTRABOND HS-1CC CURE SCHEDULE^{1,2,3}

Temperature °F (°C)	Working Time min	Full Cure Time hr
43 (6)	45	144
50 (10)	35	72
75 (24)	16	7
90 (32)	12	4
110 (43)	3	2

1. Working and full cure times are approximate, may be linearly interpolated between listed temperatures and are based on cartridge/nozzle system performance.

2. Application Temperature: Substrate and ambient air temperature should be between 43 - 110 °F (6 - 43 °C) for applications requiring IBC/IRC code compliance.

3. When ambient or base material temperature falls below 70 °F (21 °C), condition the adhesive to 70 - 75 °F (21 - 24 °C) prior to use. A high flow mixing nozzle (T34HF) may also be used to ease dispensing at colder temperatures or to increase flow rate.

^{2.} ULTRABOND HS-1CC is certified to NSF/ANSI 372 and conforms to the lead content requirements for "lead free" plumbing as defined by California, Louisiana, Maryland and Vermont state law, and the U.S. Safe Drinking Water Act.



Technical Data



FIGURE 1 - Flow Chart for the Establishment of DESIGN STRENGTH

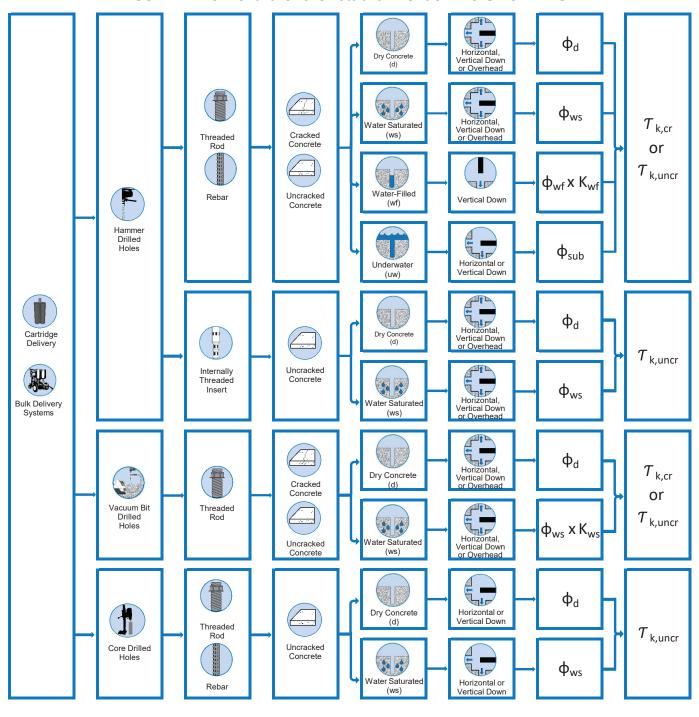


FIGURE 2 - Typical Installation Detail for Threaded Rods or Reinforcement Bars





FIGURE 3 - Typical Installation Detail for Power-Sert for Internally Threaded Inserts





Technical Data



ULTRABOND HS-1CC has been tested and assessed by an accredited independent testing laboratory in accordance with ICC-ES AC308, ACI 355.4 and ASTM E488 for use in cracked and uncracked, normal and lightweight concrete, for loading conditions including seismic and wind, for structural design to ACI 318-14 Chapter 17 (ACI 318-11/08 Appendix D) and is approved per ICC-ES ESR-4094. The design process and parameters for ULTRABOND HS-1CC are shown in Figures 1 - 3, Tables 7 - 18 for Strength Design and Tables 19 - 22 for Allowable Stress Design.

TABLE 6: ULTRABOND HS-1CC DESIGN STRENGTH INDEX

DESIGN S	TRENGTH	Drilling Method	Threaded Rod	Rebar	Internally Threaded Insert
Steel Strength	N_{sa}, V_{sa}		7	Threaded Inse	16
Concrete Breakout	N_{cb} , V_{cb} , V_{cp}		8	13	17
	Cracked Concrete	Hammer Drilled	9	14	18
	Uncracked Concrete	nammer billied	9		
Strength Design Bond Strength (SD)	Cracked Concrete	Vacuum Bit Drilled	10		
	Uncracked Concrete	vacuum bit Dillied	10		
	Uncracked Concrete	Core Drilled	11	15	
Allowable Stress	Allowable Tension Load	Hammer Drilled	19		
Design (ASD)	Allowable Shear Load	Hammer Dilleu	20	22	



Technical Data



TABLE 7: ULTRABOND HS-1CC STEEL design information for THREADED ROD¹

	Docia	n Information	Symbol	Units			T	hreaded Ro	d		
	Desig	ii iiioiiiiatioii	Cyllibol	Office	3/8"	1/2"	5/8"	3/4"	7/8"	1"	1 1/4"
	Nominal	Anchor Diameter	d	in.	0.375	0.500	0.625	0.750	0.875	1.000	1.250
	rtommar	7 thorior Blameter	u	(mm)	(9.5)	(12.7)	(15.9)	(19.1)	(22.2)	(25.4)	(31.8)
Thre	aded Rod	Cross-Sectional Area ²	A se	in. ²	0.078	0.142	0.226	0.335	0.462	0.606	0.969
111100	aueu 110u	Closs-Sectional Area	, se	(mm ²)	(50)	(92)	(146)	(216)	(298)	(391)	(625)
		Nominal Strength as	N _{sa}	lb.	4,495	8,230	13,110	19,370	26,795	35,150	56,200
	36	Governed by Steel	. · Sa	(kN)	(20.0)	(36.6)	(58.3)	(86.2)	(119.2)	(156.4)	(250.0)
	e 3	Strength	V _{sa}	lb.	2,695	4,940	7,865	11,625	16,080	21,090	33,720
	rad de 3		* 5a	(kN)	(12.0)	(22.0)	(35.0)	(51.7)	(71.5)	(93.8)	(150.0)
	ASTM A36 Grade 3 F1554 Grade 36	Reduction Factor for Seismic Shear	α _{V,seis}		0.83	0.78	0.74	0.70	0.69	0.67	0.65
	STM /	Strength Reduction Factor for Tension ³	φ					0.75			
Carbon Steel	\(\delta\)	Strength Reduction actor for Shear ³	φ					0.65			
noc				lb.	9,685	17,735	28,250	41,750	57,750	75,750	121,125
art	35	Nominal Strength as	N _{sa}	(kN)	(43.1)	(78.9)	(125.7)	(185.7)	(256.9)	(337.0)	(538.8)
	2 10 e	Governed by Steel Strength	17	lb.	5,815	10,645	16,950	25,050	34,650	45,450	72,675
	3 B7 rade	Strength	V _{sa}	(kN)	(25.9)	(47.4)	(75.4)	(111.4)	(154.1)	(202.2)	(323.3)
	STM A193 F1554 Gra	Reduction Factor for Seismic Shear	α _{V,seis}		0.60	0.58	0.57	0.55	0.53	0.50	0.46
	ASTM A193 B7 ASTM F1554 Grade 105	Strength Reduction Factor for Tension ⁴	φ					0.75			
	AS	Strength Reduction Factor for Shear ⁴	φ					0.65			
		Name in all Other met	N _{sa}	lb	7,750	14,190	22,600	28,390	39,270	51,510	82,365
	ess	Nominal Strength as Governed by Steel	™ sa	(kN)	(34.5)	(63.1)	(100.5)	(126.3)	(174.7)	(229.1)	(366.4)
<u></u>	Stainless 316	Strength	V _{sa}	lb	4,650	8,515	13,560	17,035	23,560	30,905	49,420
Stee		2	v sa	(kN)	(20.7)	(37.9)	(60.3)	(75.8)	(104.8)	(137.5)	(219.8)
Stainless Steel	A F593 CW : Type 304 &	Reduction Factor for Seismic Shear	α _{V,seis}		0.65	0.62	0.60	0.58	0.57	0.55	0.53
Stair	ASTM F593 CW Type 304 &	Strength Reduction Factor for Tension ⁴	φ					0.65			
	AS1	Strength Reduction Factor for Shear ⁴	φ					0.60			

For SI: 1 inch = 25.4 mm, 1lbf = 4.448 N, 1 psi = 0.006897 MPa

^{1.} Values provided for common rod material types are based on specified strength and calculated in accordance with ACI 318-14 Eq. 17.4.1.2 and Eq. 17.5.1.2b or ACI 318-11 Eq. (D-2) and Eq. (D-29), as applicable. Nuts and washers must be appropriate for the rod strength and type.

^{2.} Cross-sectional area is minimum stress area applicable for either tension or shear.

^{3.} For use with load combinations of IBC Section 1605.2, ACI 318-14 5.3 or ACI 318-11 9.2, as applicable, as set forth in ACI 318-14 17.3.3 or ACI 318-11 D.4.3. If the load combinations of ACI 318-11 Appendix C are used, the appropriate value of ϕ must be determined in accordance with ACI 318-11 D4.4. Values correspond to a

^{4.} For use with load combinations of IBC Section 1605.2, ACI 318-14 5.3 or ACI 318-11 9.2, as applicable, as set forth in ACI 318-14 17.3.3 or ACI 318-11 D.4.3. If the load combinations of ACI 318-11 Appendix C are used, the appropriate value of φ must be determined in accordance with ACI 318-11 D4.4. Values correspond to a brittle steel element.



Technical Data



TABLE 8: ULTRABOND HS-1CC CONCRETE BREAKOUT design information for THREADED ROD

Design Information	Symbol	Units			Thr	eaded Roo	t		
Design information	Syllibol	Units	3/8"	1/2"	5/8"	3/4"	7/8"	1"	1 1/4"
Minimum Embedment Depth	h _{ef,min}	in.	2 3/8	2 3/4	3 1/8	3 1/2	3 3/4	4	5
William Embodinent Bopti	r er,min	(mm)	(60)	(70)	(79)	(89)	(95)	(102)	(127)
Maximum Embedment Depth	h _{ef,max}	in.	7 1/2	10	12 1/2	15	17 1/2	20	25
<u>'</u>	GI,IIIdX	(mm)	(191)	(254)	(318)	(381)	(445)	(508)	(635)
Effectiveness Factor for	k _{c.cr}					17			
Cracked Concrete		SI				(7.1)			
Effectiveness Factor for	k _{c.uncr}	 SI				24			
Uncracked Concrete	0,41101	(10)							
Minimum Spacing Distance	S _{min}	in.			S	$_{nin} = C_{min}$			
		(mm)		T					
Minimum Edge Distance	C _{min}	in.	2 3/16	2 13/16	3 3/4	4 3/8	5	5 5/8	6 7/8
	111111	(mm)	(56)	(71)	(95)	(111)	(127)	(143)	(175)
Minimum Concrete Thickness	h _{min}	in.	$h_{ef} + 1.25$, [≥ 3.937] $h_{ef} + 2d_0$ where d_0 is the hole diameter						
		(mm)	$(h_{ef} + 30)$, [≥ 100])	0.				
Critical Edge Distance	C _{ac}	in.		$f \cdot \left(\frac{\min(\tau)}{\tau}\right)$					
(Uncracked Concrete Only)	ac	mm	$C_{ac} = h_e$	$_{f}\cdot\left(\frac{\min\left(\tau\right)}{}\right)$	$\kappa_{k,uncr}$; $\tau_{k,m}$	$\left(\frac{1}{100}\right)^{0.4}$ · m	$\max \left[\left(3.1 - \right) \right]$	$-0.7 \frac{h}{h_{ef}}$;1.4
Strength Reduction Factor for Tension, Concrete Failure Mode, Condition B ¹				0.65					
Strength Reduction Factor for Shear, Concrete Failure Mode, Condition B ¹	φ					0.70			

For SI: 1 inch = 25.4 mm, 1lbf = 4.448 N, 1 psi = 0.006897 MPa

^{1.} Values provided for post-installed anchors with category as determined from ACI 355.4 given for Condition B. Condition B applies without supplementary reinforcement or where pullout (bond) or pryout govern, as set forth in ACI 318-14 17.3.3 or ACI 318-11 D.4.3, as applicable, while condition A requires supplemental reinforcement. Values are for use with the load combinations Section 1605.2 of the IBC, ACI 318-14 5.3 or ACI 318-11 Section 9.2, as applicable, as set forth in ACI 318-11 D.4.3. If the load combinations of ACI 318-11 Appendix C are used, the appropriate value of *φ* must be determined in accordance with ACI 318-11 D.4.4.



Technical Data



TABLE 9: ULTRABOND HS-1CC BOND STRENGTH design information for THREADED ROD in holes drilled with a HAMMER DRILL and CARBIDE BIT - Maximum Long Term Service Temperature 110 °F (43 °C)^{1,2,3,4}

		Design Info	ormation	Symbol	Units			Th	readed F	lod		
		Design init	Jillation	Syllibol	Oilles	3/8"	1/2"	5/8"	3/4"	7/8"	1"	1 1/4"
		Minimum Embe	edment Depth	h _{ef,min}	in.	2 3/8	2 3/4	3 1/8	3 1/2	3 3/4	4	5
				61,111111	(mm)	(60)	(70)	(79)	(89)	(95)	(102)	(127)
		Maximum Embe	edment Depth	h _{ef,max}	in.	7 1/2	10	12 1/2	15	17 1/2	20	25
		<u> </u>			(mm)	(191)	(254)	(318) 1,415	(381)	(445)	(508) 1,330	(635) 1,275
		Cracked Concrete	With Sustained Load		psi (MPa)	1,415 (9.8)	1,250 (8.6)	(9.8)	1,415 (9.7)	1,200 (8.3)	(9.2)	(8.8)
	mum	Characteristic		$T_{k,cr}$	psi	1,625	1,435	1,625	1,625	1,380	1,525	1.465
	Term	Bond Strength	No Sustained Load		(MPa)	(11.2)	(9.9)	(11.2)	(11.2)	(9.5)	(10.5)	(10.1)
	rature	Uncracked			psi	2,495	2,400	2,300	2,205	2,105	2,010	1,810
150		Concrete	With Sustained Load		(MPa)	(17.2)	(16.5)	(15.9)	(15.2)	(14.5)	(13.9)	(12.5)
(66	°C)	Characteristic	No Custoined Lood	${\cal T}_{k,uncr}$	psi	2,870	2,755	2,640	2,530	2,415	2,305	2,080
		Bond Strength	No Sustained Load		(MPa)	(19.8)	(19.0)	(18.2)	(17.4)	(16.7)	(15.9)	(14.3)
		Cracked Concrete	With Sustained Load		psi	1,245	1,100	1,245	1,245	1,060	1,165	1,125
Mavi	mum	Characteristic	With Sustained Load	$T_{k,cr}$	(MPa)	(8.6)	(7.6)	(8.6)	(8.6)	(7.3)	(8.0)	(7.8)
	Term	Bond Strength	No Sustained Load	· K,Cr	psi	1,430	1,265	1,430	1,430	1,215	1,340	1,290
	rature	_			(MPa)	(9.9)	(8.7)	(9.9)	(9.9)	(8.4)	(9.2)	(8.9)
180) °F	Uncracked	With Sustained Load		psi	2,200	2,110	2,025	1,940	1,855	1,770	1,595
(82	°C)	Concrete		$T_{k,uncr}$	(MPa)	(15.2)	(14.5)	(14.0)	(13.4)	(12.8)	(12.2)	(11.0)
		Characteristic Bond Strength	No Sustained Load	.,	psi (MD-)	2,525	2,425	2,325	2,225	2,130	2,030	1,830
-		Bond Strength			(MPa) psi	(17.4) 530	(16.7) 470	(16.0) 530	(15.3) 530	(14.7) 455	(14.0) 495	(12.6) 480
		Cracked Concrete	With Sustained Load		(MPa)	(3.7)	(3.2)	(3.7)	(3.7)	(3.1)	(3.4)	(3.3)
	mum	Characteristic		$T_{k,cr}$	psi	610	540	610	610	420	570	550
	Term	Bond Strength	No Sustained Load		(MPa)	(4.2)	(3.7)	(4.2)	(4.2)	(2.9)	(3.9)	(3.8)
	erature	Uncracked	W. 0 4 1 1 1		psi	935	900	860	830	790	755	680
205		Concrete	With Sustained Load	τ	(MPa)	(6.4)	(6.2)	(5.9)	(5.7)	(5.4)	(5.2)	(4.7)
(96	°C)	Characteristic	No Sustained Load	${m au}_{k,uncr}$	psi	1,075	1,035	990	950	905	865	780
		Bond Strength			(MPa)	(7.4)	(7.1)	(6.8)	(6.6)	(6.2)	(6.0)	(5.4)
		Reduction Factor for	Seismic Tension ⁵	α _{N,seis}			1.00		0.77	1.00	0.97	0.96
40			Dry Concrete	ϕ_d					0.65			
ous	Stı	rength Reduction	Water Saturated Concrete	φ _{ws}		0.	65			0.55		
inu		ors for Permissible	Water-Filled Holes	ϕ_{wf}				0.55			0.	45
Continuous Inspection	Instal	lation Conditions ^{6,7,8}	in Concrete	K wf				1.00			0.96	0.88
0 –			Underwater Holes in Concrete	φ _{uw}					0.65			
			Dry Concrete	\$ d					0.65			
on On	Strength	rength Reduction	Water Saturated Concrete	φ _{ws}		0.	55			0.45		$\overline{}$
iodi		ors for Permissible	Water-Filled Holes	ϕ_{wf}		-		1	0.45			
Periodic Inspection		lation Conditions ^{6,7,8}	in Concrete	K _{wf}				1.00	00		0.92	0.75
			Underwater Holes in Concrete	Φ _{uw}				1.00	0.55		0.52	0.73
			Underwater Holes in Concrete	Ψ uw					บ.บบ			

For SI: 1 inch = 25.4 mm, 1 lbf = 4.448 N, 1 psi = 0.006897 MPa

- 1. Characteristic bond strength values correspond to concrete compressive strength f'c =2,500 psi (17.2 MPa). For uncracked concrete compressive strength f'c between 2,500 psi (17.2 MPa) and 8,000 psi (55.2 MPa), the tabulated characteristic bond strength may be increased by a factor of (f'c/2,500)^{0.1} (for SI: (f'c/17.2)^{0.1}). For cracked concrete, no increase in bond strength is permitted.
- 2. Lightweight concrete may be used by applying a reduction factor as given in ACI 318-14 17.2.6 or ACI 318-11 Appendix D section D3.6 as applicable.
- 3. Short term elevated concrete temperatures are those that occur over brief intervals, e.g., as a results of diurnal cycling. Long term concrete temperatures are roughly constant over significant periods of time.
- 4. Characteristic bond strength values are for sustained loads (when noted), including dead and live loads.
- 5. For structures in regions assigned to Seismic Design Category C, D, E, or F, the bond strength values shall be multiplied by $\alpha_{n,seis}$.
- 6. The tabulated value of \$\phi\$ applies when load combinations of Section 1605.2 of the IBC or ACI 318-14 5.3 (ACI 318-11 9.2), are used in accordance with ACI 318-14 17.3.3 (ACI 318-11 D.4.3). If the load combinations of ACI 318-11 Appendix C are used, the appropriate value of φ shall be determined in accordance with ACI 318 D.4.4.
- 7. The values of φ correspond to Condition B as described in ACI 318-14 17.3.3 (ACI 318-11 D.4.3) for post-installed anchors designed using the load combinations of IBC Section 1605.2. If the load combinations in ACI 318-11 Appendix C are used, the corresponding value of φ shall be determined.
- 8. The values of \$\phi\$ correspond to the anchor category as set forth in ACI 318-14 17.3.3 (ACI 318-11 D.4.3). The \$\phi\$ factor of 0.65 represents a Category 1, 0.55 a Category 2 and 0.45 a Category 3.



Technical Data



TABLE 10: ULTRABOND HS-1CC BOND STRENGTH design information for THREADED ROD in MILWAUKEE VACUUM BIT DRILLED HOLES - Maximum Long Term Service Temperature 110 °F (43 °C)^{1,2,3,4}

BII DI	RILLED HOLES - N	Maximum Long Term S	service Temperature 1	10°F (43°C	ر (ر			3 3/4 4 8 (95) (102) (12) 17 1/2 20 2 (445) (508) (63 1,035 1,185 1,1 (7.1) (8.2) (7 1,185 1,360 1,3 (8.2) (9.4) (9 1,955 1,880 1,7 (13.5) (13.0) (11 2,245 2,160 1,5 (15.5) (14.9) (13 910 1,045 1,0 (6.3) (7.2) (6 1,045 1,200 1,1 (7.2) (8.3) (8 1,720 1,655 1,5 (11.9) (11.4) (10 1,975 1,900 1,7 (13.6) (13.1) (12 385 445 43 (2.7) (3.1) (3 445 510 48 (3.1) (3.5) (3		
		Design Information		Symbol	Units					
		Doorgii iiioriiiaaoii		- Jimoi		5/8"	3/4"		_	1 1/4"
	Min	imum Embedment Depth	1	h _{ef,min}	in.	3 1/8	3 1/2		1" 4 (102) 20 (508) 1,185 (8.2) 1,360 (9.4) 1,880 (13.0) 2,160 (14.9) 1,045 (7.2) 1,200 (8.3) 1,655 (11.4) 1,900 (13.1) 445 (3.1) 510 (3.5) 705 (4.9) 810 (5.6) 0.97	5
	Maximum Short Term Temperature 150 °F (66 °C) Maximum Short Term Temperature 180 °F (82 °C) Maximum Short Term Temperature 205 °F (96 °C) Maximum Short Term Temperature Characteristic Bond Strength No Sustain No Sustain			61,111111	(mm)	(79)	(89)	_ /		(127)
	Max	imum Embedment Depth	1	h _{ef.max}	in.	12 1/2	15	3 3/4 4 8 (95) (102) (12 17 1/2 20 2 (445) (508) (63 1,035 1,185 1,1 (7.1) (8.2) (7 1,185 1,360 1,3 (8.2) (9.4) (9 1,955 1,880 1,7 (13.5) (13.0) (11 2,245 2,160 1,5 (15.5) (14.9) (13 910 1,045 1,0 (6.3) (7.2) (6 1,045 1,200 1,1 (7.2) (8.3) (8 1,720 1,655 1,5 (11.9) (11.4) (10 1,975 1,900 1,7 (13.6) (13.1) (12 385 445 43 (2.7) (3.1) (3 445 510 48 (3.1) (3.5) (3		
		'	<u> </u>	or, max	(mm)	(318)	(381)			(635)
		Cracked Concrete	With Sustained Load		psi	1,175	1,005			1,140
	Maximum	Characteristic		${\cal T}_{k,cr}$	(MPa)	(8.1) 1,350	(6.9) 1,155			(7.9) 1,310
	Short Term	Bond Strength	No Sustained Load		psi (MPa)	(9.3)	(8.0)			(9.0)
					(IVIPa) psi	2,105	2,030	. ,		1,730
		Uncracked Concrete	With Sustained Load		(MPa)	(14.5)	(14.0)			(11.9)
	(66 °C)			$T_{k,uncr}$	psi	2.415	2,330	,		1,985
		Bond Strength	No Sustained Load		(MPa)	(16.7)	(16.1)		2 20) (508) 5 1,185) (8.2) 5 1,360) (9.4) 5 1,880 5) (13.0) 5 2,160 (14.9) 1,045) (7.2) 5 1,200 (8.3) 0 1,655 (11.4) 5 1,900 (13.1) 445 (3.1) 510 (3.5) 705 (4.9) 810 (5.6) 0 0.6	(13.7)
					psi	1,035	885	,	, ,	1,005
			With Sustained Load	_	(MPa)	(7.1)	(6.1)			(6.9)
				${\cal T}_{k,cr}$	psi	1,190	1,015	, ,		1,155
		Bond Strength	No Sustained Load		(MPa)	(8.2)	(7.0)		1,200 (8.3) 1,655 (11.4) ((8.0)
			Mith Occatain and Land	stained Load psi 1,850 1,785 1,720		, ,	1,525			
			With Sustained Load	- Τ _{k,uncr}	(MPa)	(12.8)	(12.3)	(11.9)	(11.4)	(10.5)
			No Sustained Load	l k,uncr	psi	2,125	2,050	1,975	1,900	1,750
		Bond Strength	No Sustained Load		(MPa)	(14.7)	(14.1)	(13.6)	(13.1)	(12.1)
		Cracked Concrete	With Sustained Load		psi	440	375			430
	Maximum		With Sustained Load	$T_{k,cr}$	(MPa)	(3.0)	(2.6)	(2.7)		(3.0)
			No Sustained Load	, K,CF	psi	505	435			490
			110 Guotamou Loud		(MPa)	(3.5)	(3.0)		, ,	(3.4)
		Uncracked Concrete	With Sustained Load		psi	790	760			
		•		${\cal T}_{k,uncr}$	(MPa)	(5.4)	(5.2)			
	,	Bond Strength	No Sustained Load	10,01101	psi	905	875			
			. 5		(MPa)	(6.2)	(6.0)	` '	, ,	, ,
		on Factor for Seismic Ten	sion	α _{N,seis}		1.00	0.77	1.00	0.97	0.96
ous		Dry Co	oncrete	Ø d				0.65		
Continuous Inspection		Water S	aturated	φ _{ws}		0.4	45	0.55	445 510 490 (3.1) (3.5) (3.4 735 705 650 (5.1) (4.9) (4.5 840 810 745 (5.8) (5.6) (5.1 1.00 0.97 0.96 0.65	
Con	Conditions ^{6,7,8}	Con	crete	K ws				1.00		
c UC	Strength Reduction Factors for	Dry Co	oncrete	Ø d				0.65		
Periodic Inspection	Permissible	Water S	aturated	φ _{ws}			0.45		0.	55
Pe Insl	Installation Conditions ^{6,7,8}		crete	K _{ws}		0.89 0.96 1.00				

For SI: 1 inch = 25.4 mm, 1 lbf = 4.448 N, 1 psi = 0.006897 MPa

For pound-inch units: 1 mm = 0.03937 inch, 1 N = 0.2248 lbf, 1MPa = 145.0 psi

1. Characteristic bond strength values correspond to concrete compressive strength f'_c =2,500 psi (17.2 MPa). For uncracked concrete compressive strength f'_c between 2,500 psi (17.2 MPa) and 8,000 psi (55.2 MPa), the tabulated characteristic bond strength may be increased by a factor of (f'c /2,500)^{0.1} (for SI: (f'c /17.2)^{0.1}). For cracked concrete, no increase in bond strength is permitted.

- 2. Lightweight concrete may be used by applying a reduction factor as given in ACI 318-14 17.2.6 or ACI 318-11 Appendix D section D3.6 as applicable.
- 3. Short term elevated concrete temperatures are those that occur over brief intervals, e.g., as a results of diurnal cycling. Long term concrete temperatures are roughly constant over significant periods of time.
- 4. Characteristic bond strength values are for sustained loads (when noted), including dead and live loads.
- 5. For structures in regions assigned to Seismic Design Category C, D, E, or F, the bond strength values shall be multiplied by $\alpha_{n,seis}$
- 6. The tabulated value of φ applies when load combinations of Section 1605.2 of the IBC or ACI 318-14 5.3 (ACI 318-11 9.2), are used in accordance with ACI 318-14 17.3.3 (ACI 318-11 D.4.3). If the load combinations of ACI 318-11 Appendix C are used, the appropriate value of φ shall be determined in accordance with ACI 318
- 7. The values of ϕ correspond to Condition B as described in ACI 318-14 17.3.3 (ACI 318-11 D.4.3) for post-installed anchors designed using the load combinations of IBC Section 1605.2. If the load combinations in ACI 318-11 Appendix C are used, the corresponding value of φ shall be determined.
- 8. The values of φ correspond to the anchor category as set forth in ACI 318-14 17.3.3 (ACI 318-11 D.4.3). The φ factor of 0.65 represents a Category 1, 0.55 a Category 2 and 0.45 a Category 3.

Revision 5.2

10



Technical Data



TABLE 11: ULTRABOND HS-1CC **BOND STRENGTH** design information for **THREADED ROD** in **CORE DRILLED HOLES-** Maximum Long Term Service Temperature 110 °F (43 °C)^{1,2,3,4}

		Design Inforn	nation	Symbol	Units			Thread	ed Rod		
		Doorgii iiioiii		ojbo.	00	1/2"	5/8"	3/4"	7/8"	1"	1 1/4"
	N	linimum Embedm	nent Depth	h _{ef,min}	in. (mm)	2 3/4 (70)	3 1/8 (79)	3 1/2 (89)	3 3/4 (95)	4 (102)	5 (127)
	M	laximum Embedn	nent Depth	h _{ef,max}	in. (mm)	10 (254)	12 1/2 (318)	15 (381)	17 1/2 (445)	20 (508)	25 (635)
	mum Short n Loading	Uncracked Concrete	With Sustained Load	π	psi (MPa)				95 .9)		
	mperature °F (66 °C)	Characteristic Bond Strength	No Sustained Load	I k,uncr					145 .9)		
	mum Short n Loading	Uncracked Concrete	With Sustained Load	τ	psi (MPa)			880 (6.1)			
	nperature ° F (82 °C)	Characteristic Bond Strength	No Sustained Load	· T _{k,uncr}	psi (MPa)			,)10 .0)		
nous	_	duction Factors	Dry Concrete	ф d				0.	65		
Continuous Inspection		tions ^{5,6,7,8}	Water Saturated Concrete	φ _{ws}				0.	65		
Periodic Inspection	Strength Reduction Factors for Permissible Installation		Dry Concrete	ф d			_	0.	65	_	
Peric Inspe		itions ^{5,6,7,8}	Water Saturated Concrete	φ _{ws}				0.	55		·

For SI: 1 inch = 25.4 mm, 1 lbf = 4.448 N, 1 psi = 0.006897 MPa

- 1. Characteristic bond strength values correspond to concrete compressive strength f'_c =2,500 psi (17.2 MPa). For uncracked concrete compressive strength f'_c between 2,500 psi (17.2 MPa) and 8,000 psi (55.2 MPa), the tabulated characteristic bond strength may be increased by a factor of (f'_c /2,500)^{0.1} (for SI: (f'_c /17.2)^{0.1}). For cracked concrete, no increase in bond strength is permitted.
- 2. Lightweight concrete may be used by applying a reduction factor as given in ACI 318-14 17.2.6 or ACI 318-11 Appendix D section D3.6 as applicable.
- 3. Short term elevated concrete temperatures are those that occur over brief intervals, e.g., as a results of diurnal cycling. Long term concrete temperatures are roughly constant over significant periods of time.
- 4. Characteristic bond strength values are for sustained loads (when noted), including dead and live loads.
- 5. K factor not listed for conditions where K = 1.0.
- 6. The tabulated value of φ applies when load combinations of Section 1605.2 of the IBC or ACI 318-14 5.3 (ACI 318-11 9.2), are used in accordance with ACI 318-14 17.3.3 (ACI 318-11 D.4.3). If the load combinations of ACI 318-11 Appendix C are used, the appropriate value of φ shall be determined in accordance with ACI 318 D.4.4.
- 7. The values of ϕ correspond to Condition B as described in ACI 318-14 17.3.3 (ACI 318-11 D.4.3) for post-installed anchors designed using the load combinations of IBC Section 1605.2. If the load combinations in ACI 318-11 Appendix C are used, the corresponding value of ϕ shall be determined.
- 8. The values of φ correspond to the anchor category as set forth in ACI 318-14 17.3.3 (ACI 318-11 D.4.3). The φ factor of 0.65 represents a Category 1, 0.55 a Category 2 and 0.45 a Category 3.



Technical Data



TABLE 12: ULTRABOND HS-1CC STEEL design information for REBAR¹

	esign Information	Symbol	Units				Reba	r Size			
D	esign information	Symbol	Units	#3	#4	#5	#6	#7	#8	#9	#10
N	ominal Bar Diameter	d _a	in.	0.375	0.500	0.625	0.750	0.875	1.000	1.127	1.270
INC	Offilial Bai Diametel	u a	(mm)	(9.5)	(12.7)	(15.9)	(19.1)	(22.2)	(25.4)	(28.6)	(32.3)
	Rebar	A se	in. ²	0.110	0.200	0.310	0.440	0.600	0.790	1.000	1.270
Cr	ross-Sectional Area ²	∧ se	(mm ²)	(71)	(129)	(200)	(284)	(387)	(510)	(645)	(819)
	Name in all Other month	N _{sa}	lb.	6,600	12,000	18,600	26,400				
	Nominal Strength as Governed by	I V sa	(kN)	(29.4)	(53.4)	(82.7)	(117.4)	Gı	ade 40 rei	nforcing ba	ırs
	Steel Strength	V _{sa}	lb.	3,960	7,200	11,160	15,840				
0	Cider Guerigar	v sa	(kN)	(17.6)	(32.0)	(49.6)	(70.5)				
ASTM A615 Grade 40	Reduction Factor for Seismic Shear	α _{V,seis}		0.70	0.74	0.78	0.82		ASTM	1 A615	
AS	Strength Reduction	φ					0.	75			
	Factor for Tension ³	7									
	Strength Reduction	φ					0.	65	(25.4) (28.6) (32. 0.790		
	Factor for Shear ³	7							1.000 1.127 1 (25.4) (28.6) (3 (25.4) (28.6) (3 (25.4) (28.6) (3 (25.4) (25.4) (28.6) (3 (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.4) (25.		
	Nominal Strength	N _{sa}	lb.								101,600
	as Governed by		(kN)		,	` /					(451.9)
	Steel Strength	V _{sa}	lb.		,	l					60,960
20 20			(kN)	(23.5)	(42.7)	(66.2)	(93.9)	(128.1)	(168.7)	(213.5)	(271.2)
ASTM A706 Grade 60	Reduction Factor for Seismic Shear	α _{V,seis}		0.70	0.74	0.78	0.82	0.73	0.63	0.53	0.42
AS	Strength Reduction	φ					0.	75			
	Factor for Tension ³										
	Strength Reduction Factor for Shear ³	φ					0.	65			
	Factor for Snear			0.000	40.000	07.000		54000	74.400	00.000	111000
	Nominal Strength	N _{sa}	lb.					I			
	as Governed by		(kN)	,	,				, ,	. ,	
10	Steel Strength	V _{sa}	lb.								
60	Reduction Factor		(kN)	(20.4)	(46.0)	(74.5)	(105.7)	(144.1)	(109.0)	(240.2)	(305.1)
ASTM A615 Grade 60	for Seismic Shear	α _{V,seis}		0.70	0.74	0.78	0.82	0.73	0.63	0.53	0.42
AS O	Strength Reduction Factor for Tension ⁴	φ					0.	65			
	Strength Reduction Factor for Shear ⁴	φ					0.	60			
	Nominal Strength	N _{sa}	lb.	11,000	20,000	31,000	44,000	60,000	l '		127,000
	as Governed by	· · sa	(kN)	(48.9)	,	(137.9)	(195.7)	(266.9)	, ,		(564.9)
	Steel Strength	V _{sa}	lb.	6,600			26,400	36,000			76,200
315	_	Sa	(kN)	(29.4)	(53.4)	(82.7)	(117.4)	(160.1)	(210.8)	(266.9)	(339.0)
ASTM A615 Grade 75	Reduction Factor for Seismic Shear	α _{V,seis}		0.70	0.74	0.78	0.82	0.73	0.63	0.54	0.42
AS G	Strength Reduction Factor for Tension ⁴	φ					0.	65			
	Strength Reduction Factor for Shear ⁴	φ		3,960							
	n = 25.4 mm, 1lbf = 4.448 N, 1 psi		_	•							

For SI: 1 inch = 25.4 mm, 1lbf = 4.448 N, 1 psi = 0.006897 MPa

For pound-inch units: 1 mm = 0.03937 inch, 1 N = 0.2248 lbf, 1MPa = 145.0 psi

Revision 5.2

^{1.} Values provided for common rod material types are based on specified strength and calculated in accordance with ACI 318-14 Eq. 17.4.1.2 and Eq. 17.5.1.2b or ACI 318-11 Eq. (D-2) and Eq. (D-29), as applicable. Nuts and washers must be appropriate for the rod strength and type.

 $^{2. \ \, \}text{Cross-sectional area is minimum stress area applicable for either tension or shear}$

^{3.} For use with load combinations of IBC Section 1605.2, ACI 318-14 5.3 or ACI 318-11 9.2, as applicable, as set forth in ACI 318-14 17.3.3 or ACI 318-11 D.4.3. If the load combinations of ACI 318-11 Appendix C are used, the appropriate value of ϕ must be determined in accordance with ACI 318-11 D4.4. Values correspond to a ductile steel element.

^{4.} For use with load combinations of IBC Section 1605.2, ACI 318-14 5.3 or ACI 318-11 9.2, as applicable, as set forth in ACI 318-14 17.3.3 or ACI 318-11 D.4.3. If the load combinations of ACI 318-11 Appendix C are used, the appropriate value of *φ* must be determined in accordance with ACI 318-11 D4.4. Values correspond to a brittle steel element.



Technical Data



TABLE 13: ULTRABOND HS-1CC CONCRETE BREAKOUT design information for REBAR, in holes drilled with a HAMMER DRILL and CARBIDE BIT

Design Information	Symbol	Units				Reba	r Size			
200.911 111011114.1011	- Jillion	• • • • • • • • • • • • • • • • • • •	#3	#4	#5	#6	#7	#8	#9	#10
Minimum Embedment Depth	h _{ef,min}	in. (mm)	2 3/8 (60)	2 3/4 (70)	3 1/8 (79)	3 1/2 (89)	3 3/4 (95)	4 (102)	4 1/2 (114)	5 (127)
Maximum Embedment Depth	h _{ef,max}	in. (mm)	7 1/2 (191)	10 (254)	12 1/2 (318)	15 (381)	17 1/2 (445)	20 (508)	22 1/2 (572)	25 (635)
Effectiveness Factor Cracked Concrete	k _{c,cr}	 SI					7 (.1)			
Effectiveness Factor Uncracked Concrete	K _{c,uncr}	 SI				_	4 10)			
Minimum Spacing Distance	S _{min}	in. (mm)				S min =	= C _{min}			
Minimum Edge Distance	C _{min}	in. (mm)	2 3/16 (56)	2 13/16 (71)	3 3/4 (95)	4 3/8 (111)	5 (127)	5 5/8 (143)	6 1/4 (159)	6 7/8 (175)
Minimum Concrete Thickness	h _{min}	in. (mm)		, [≥ 3.937] , [≥ 100])		h _{ef} + 2	2d ₀ where d _o	is the hole d	ameter	
Critical Edge Distance	C ac	in.	C_{ac}	$= h_{ef} \cdot \left(\frac{\text{mi}}{}\right)$	$ \frac{\sin\left(\tau_{k,uncr};\tau_{k}\right)}{1160} $) 0.4 · n	$\max \left[\left(3.1 - \right) \right]$	$0.7 \frac{h}{h_{ef}}$);1.	4	
(Uncracked Concrete Only)	ac	mm	C_{ac}	$=h_{ef}\cdot\left(\frac{\mathrm{mi}}{}\right)$	$\frac{\ln\left(\tau_{k,uncr};\tau_{k}\right)}{8}$	$\left(\frac{1}{10000000000000000000000000000000000$	$\max \left[\left(3.1 - \right) \right]$	$0.7 \frac{h}{h_{ef}}$);1.	4	
Strength Reduction Factor for Tension, Concrete Failure Mode, Condition B ¹	φ					0.	65			
Strength Reduction Factor for Shear, Concrete Failure Mode, Condition B ¹	φ					0.	70			

For **SI**: 1 inch = 25.4 mm, 1lbf = 4.448 N, 1 psi = 0.006897 MPa

^{1.} Values provided for post-installed anchors with category as determined from ACI 355.4 given for Condition B. Condition B applies without supplementary reinforcement or where pullout (bond) or pryout govern, as set forth in ACI 318-14 17.3.3 or ACI 318-11 D.4.3, as applicable, while condition A requires supplemental reinforcement. Values are for use with the load combinations Section 1605.2 of the IBC, ACI 318-14 5.3 or ACI 318-11 Section 9.2, as applicable, as set forth in ACI 318-11 D.4.3. If the load combinations of ACI 318-11 Appendix C are used, the appropriate value of ϕ must be determined in accordance with ACI 318-11 D.4.4.



Technical Data



TABLE 14: ULTRABOND HS-1CC **BOND STRENGTH** design information for **REBAR** in holes drilled with a **HAMMER DRILL** and **CARBIDE BIT -** Maximum Long Term Service Temperature 110 °F (43 °C)^{1,2,3,4}

		Design In	formation	Symbol	Units					r Size			
		Design in	iormanori	Cyllida	Oilits	#3	#4	#5	#6	#7	#8	#9	#10
		Minimum Emb	pedment Depth	h _{ef,min}	in. (mm)	2 3/8 (60)	2 3/4 (70)	3 1/8 (79)	3 1/2 (89)	3 3/4 (95)	4 (102)	4 1/2 (114)	5 (127)
		Maximum Eml	bedment Depth	h _{ef,max}	in. (mm)	7 1/2 (191)	10 (254)	12 1/2 (318)	15 (381)	17 1/2 (445)	20 (508)	22 1/2 (572)	25 (635)
		Cracked Concrete	With Sustained Load		psi (MPa)	1,450 (10.0)	1,420 (9.8)	1,400 (9.7)	1,365 (9.4)	1,295 (8.9)	1,230 (8.5)	1,160 (8.0)	1,080 (7.4)
Short	imum t Term	Characteristic Bond Strength	No Sustained Load	${\cal T}_{k,cr}$	psi (MPa)	1,665 (11.5)	1,635 (11.3)	1,605 (11.1)	1,570 (10.8)	1,490 (10.3)	1,410 (9.7)	1,330 (9.2)	1,240 (8.5)
150	erature 0 °F 5 °C)	Uncracked Concrete	With Sustained Load	_	psi (MPa)	2,180 (15.0)	2,095 (14.4)	2,010 (13.9)	1,930 (13.3)	1,845 (12.7)	1,760 (12.1)	1,675 (11.5)	1,580 (10.9)
(00	()	Characteristic Bond Strength	No Sustained Load	${\cal T}_{k,uncr}$	psi (MPa)	2,505 (17.3)	2,405 (16.6)	2,310 (15.9)	2,215 (15.3)	2,120 (14.6)	2,020 (13.9)	1,925 (13.3)	1,815 (12.5)
		Cracked Concrete	With Sustained Load	au	psi (MPa)	1,275 (8.8)	1,255 (8.7)	1,230 (8.5)	1,205 (8.3)	1,140 (7.9)	1,080 (7.4)	1,020 (7.0)	950 (6.6)
Short	imum Term	Characteristic Bond Strength	No Sustained Load	T _{k,cr}	psi (MPa)	1,465 (10.1)	1,440 (9.9)	1,415 (9.8)	1,380 (9.5)	1,310 (9.0)	1,240 (8.5)	1,170 (8.1)	1,090 (7.5)
180	erature 0 °F ! °C)	Uncracked Concrete	With Sustained Load	<i>T</i>	psi (MPa)	1,920 (13.2)	1,845 (12.7)	1,770 (12.2)	1,700 (11.7)	1,625 (11.2)	1,550 (10.7)	1,475 (10.2)	1,390 (9.6)
(02	. 0)	Concrete Characteristic Bond Strength No Sustained Load		$T_{k,uncr}$	psi (MPa)	2,205 (15.2)	2,120 (14.6)	2,035 (14.0)	1,950 (13.4)	1,865 (12.9)	1,780 (12.3)	1,695 (11.7)	1,595 (11.0)
		Cracked Concrete	With Sustained Load	τ	psi (MPa)	545 (3.8)	535 (3.7)	525 (3.6)	515 (3.6)	485 (3.3)	460 (3.2)	435 (3.0)	405 (2.8)
Short	imum t Term	Characteristic Bond Strength	No Sustained Load	${\cal T}_{k,cr}$	psi (MPa)	625 (4.3)	615 (4.2)	600 (4.1)	590 (4.1)	560 (3.9)	530 (3.7)	500 (3.4)	465 (3.2)
20	erature 5 °F 5 °C)	Uncracked Concrete	With Sustained Load	${\cal T}_{k,uncr}$	psi (MPa)	820 (5.7)	785 (5.4)	755 (5.2)	725 (5.0)	690 (4.8)	660 (4.6)	630 (4.3)	590 (4.1)
(00	, O ₁	Characteristic Bond Strength	No Sustained Load	' k,uncr	psi (MPa)	940 (6.5)	905 (6.2)	865 (6.0)	830 (5.7)	795 (5.5)	760 (5.2)	720 (5.0)	680 (4.7)
		Reduction Factor	- Seismic Tension ⁵	α _{N,seis}				1			0.	97	0.96
(0 –	Reduction Factor - Seismic Tension ⁵ Dry Concre		Dry Concrete	\$ d					0.	65			
Jour Tion	Strength Reduction Wa		Water Saturated Concrete	φ _{ws}		0.	65			0.	55		
ntin	Installation Water-Filled Ho		Water-Filled Holes	ϕ_{wf}				0.55				0.45	
Cor	Conditions ^{6,7,8} in Concrete			K wf				1.00			0.96	0.92	0.88
$\vdash \vdash$	Underwater Holes in Conc		Underwater Holes in Concrete	φ _{uw}		3.33							
ں ج	Stren	gth Reduction	,	φ _d		^	EE		0.	65	1 E		
odic			Water Saturated Concrete	φ _{ws}		0.	55		0	45	45		
Perik Ispe	Factors for Permissible Water-Filled Holes		ϕ_{wf} K_{wf}				1.00	0.	40	0.92	0.83	0.75	
느 드	Co	onditions ^{6,7,8}	Underwater Holes in Concrete	ϕ_{uw}				1.00	0	55	0.82	0.03	0.73

For SI: 1 inch = 25.4 mm, 1 lbf = 4.448 N, 1 psi = 0.006897 MPa

^{1.} Characteristic bond strength values correspond to concrete compressive strength f'_c =2,500 psi (17.2 MPa). For uncracked concrete compressive strength f'_c between 2,500 psi (17.2 MPa) and 8,000 psi (55.2 MPa), the tabulated characteristic bond strength may be increased by a factor of (f'_c/2,500)^{0.1} (for SI: (f'_c/17.2)^{0.1}). For cracked concrete, no increase in bond strength is permitted.

^{2.} Lightweight concrete may be used by applying a reduction factor as given in ACI 318-14 17.2.6 or ACI 318-11 Appendix D section D3.6 as applicable.

^{3.} Short term elevated concrete temperatures are those that occur over brief intervals, e.g., as a results of diurnal cycling. Long term concrete temperatures are roughly constant over significant periods of time.

^{4.} Characteristic bond strength values are for sustained loads (when noted), including dead and live loads.

^{5.} For structures in regions assigned to Seismic Design Category C, D, E, or F, the bond strength values shall be multiplied by $\alpha_{n,seis}$.

^{6.} The tabulated value of φ applies when load combinations of Section 1605.2 of the IBC or ACI 318-14 5.3 (ACI 318-11 9.2), are used in accordance with ACI 318-14 17.3.3 (ACI 318-11 D.4.3). If the load combinations of ACI 318-11 Appendix C are used, the appropriate value of φ shall be determined in accordance with ACI 318 D.4.4.

^{7.} The values of φ correspond to Condition B as described in ACI 318-14 17.3.3 (ACI 318-11 D.4.3) for post-installed anchors designed using the load combinations of IBC Section 1605.2. If the load combinations in ACI 318-11 Appendix C are used, the corresponding value of φ shall be determined.

^{8.} The values of \$\phi\$ correspond to the anchor category as set forth in ACI 318-14 17.3.3 (ACI 318-11 D.4.3). The \$\phi\$ factor of 0.65 represents a Category 1, 0.55 a Category 2 and 0.45 a Category 3.



Technical Data



TABLE 15: ULTRABOND HS-1CC **BOND STRENGTH** design information for **REBAR** in **CORE DRILLED HOLES -** Maximum Long Term Service Temperature 110 °F (43 °C)^{1,2,3,4}

		Decign Infor	mation	Symbol	Units			F	Rebar Siz	е		
		Design Infor	mation	Symbol	Units	#4	#5	#6	#7	#8	#9	#10
		Minimum Embed	ment Depth	h _{ef,min}	in. (mm)	2 3/4 (70)	3 1/8 (79)	3 1/2 (89)	3 3/4 (95)	4 (102)	4 1/2 (114)	5 (127)
		Uncracked Concrete Characteristic Bond Strength Uncracked Concrete Characteristic Bond Strength Uncracked Concrete Characteristic Bond Strength With Sustained Log With Sustained Log No Sustained Log No Sustained Log No Sustained Log No Sustained Log		h _{ef,max}	in. (mm)	10 (254)	12 1/2 (318)	15 (381)	17 1/2 (445)	20 (508)	22 1/2 (572)	25 (635)
Sho	ximum rt Term perature		With Sustained Load	${m au}_{k,uncr}$	psi (MPa)	1,535 (10.6)	1,490 (10.3)	1,380 (9.5)	1,270 (8.8)	1,160 (8.0)	1,045 (7.2)	920 (6.3)
1	50 °F 6 °C)	-	No Sustained Load	, k,uncr	psi (MPa)	1,760 (12.1)	1,715 (11.8)	1,585 (10.9)	1,460 (10.1)	1,330 (9.2)	1,200 (8.3)	1,055 (7.3)
Sho	ximum rt Term perature	Concrete		${\cal T}_{k,uncr}$	psi (MPa)	1,350 (9.3)	1,315 (9.1)	1,215 (8.4)	1,120 (7.7)	1,020 (7.0)	920 (6.3)	810 (5.6)
18	80 °F 2 °C)	-	No Sustained Load	r k,uncr	psi (MPa)	1,550 (10.7)	1,510 (10.4)	1,395 (9.6)	1,285 (8.9)	1,170 (8.1)	1,060 (7.3)	930 (6.4)
Continuous Inspection		gth Reduction for Permissible	Dry Concrete	ф d					0.65			
Contii Inspe	Installation Conditions ^{5,6,7,8} Water Saturated Conc			φ _{ws}					0.65			
Periodic Ispection	Strength Reduction Pry Concrete Factors for Permissible		Dry Concrete	ф d					0.65			
Peri Inspé	Strength Reduction Factors for Permissible Installation Conditions ^{5,6,7,8} Water Saturated Concr			φ _{ws}					0.55			

For SI: 1 inch = 25.4 mm, 1 lbf = 4.448 N, 1 psi = 0.006897 MPa

- 1. Characteristic bond strength values correspond to concrete compressive strength f'_c =2,500 psi (17.2 MPa). For uncracked concrete compressive strength f'_c between 2,500 psi (17.2 MPa) and 8,000 psi (55.2 MPa), the tabulated characteristic bond strength may be increased by a factor of (f'_c /2,500)^{0.1} (for SI: (f'_c /17.2)^{0.1}). For cracked concrete, no increase in bond strength is permitted.
- 2. Lightweight concrete may be used by applying a reduction factor as given in ACI 318-14 17.2.6 or ACI 318-11 Appendix D section D3.6 as applicable.
- 3. Short term elevated concrete temperatures are those that occur over brief intervals, e.g., as a results of diurnal cycling. Long term concrete temperatures are roughly constant over significant periods of time.
- Characteristic bond strength values are for sustained loads (when noted), including dead and live loads.
- 5. K factor not listed for conditions where K = 1.0.
- 6. The tabulated value of φ applies when load combinations of Section 1605.2 of the IBC or ACI 318-14 5.3 (ACI 318-11 9.2), are used in accordance with ACI 318-14 17.3.3 (ACI 318-11 D.4.3). If the load combinations of ACI 318-11 Appendix C are used, the appropriate value of φ shall be determined in accordance with ACI 318 D.4.4.
- 7. The values of ϕ correspond to Condition B as described in ACI 318-14 17.3.3 (ACI 318-11 D.4.3) for post-installed anchors designed using the load combinations of IBC Section 1605.2. If the load combinations in ACI 318-11 Appendix C are used, the corresponding value of ϕ shall be determined.
- 8. The values of φ correspond to the anchor category as set forth in ACI 318-14 17.3.3 (ACI 318-11 D.4.3). The φ factor of 0.65 represents a Category 1, 0.55 a Category 2 and 0.45 a Category 3.



Technical Data



TABLE 16: ULTRABOND HS-1CC STEEL design information for POWER-SERT INTERNALLY THREADED INSERTS¹

	Design Information	Symbol	Units		In	sert Designati	on	
	Design information	Зушьог	Ullits	PS2-38	PS2-12	PS2-58	PS2-34	PS2-1
Int	ternal Thread Size (UNC)	d_t	inTPI	3/8 - 16	1/2-13	5/8 - 11	3/4 - 10	1 - 8
N	ominal Anchor Diameter	d _a	in. (mm)	0.488 (12.4)	0.595 (15.1)	0.819 (20.8)	0.898 (22.8)	1.450 (36.8)
	Cross-Sectional Area ²	A se	in. ² (mm ²)	0.102 (66)	0.135 (87)	0.302 (195)	0.385 (248)	0.785 (506)
Sį	pecified Tensile Strength	F _{uta}	psi (MPa)			64,000 (440)		
erts	Nominal Strength	N _{sa}	lb. (kN)	6,525 (29.0)	8,670 (38.6)	19,320 (85.9)	24,630 (109.6)	50,265 (223.6)
el Inse 32)	as Governed by Steel Strength	V _{sa}	lb. (kN)	3,915 (17.4)	5,200 (23.1)	11,595 (51.6)	14,780 (65.7)	30,160 (134.2)
Carbon Steel Inserts (PS2)	Strength Reduction Factor for Tension ³	φ				0.75		
Carb	Strength Reduction Factor for Shear ³	φ				0.65		
	Deales Information	0	11-24-		In	sert Designati	on	
	Design Information	Symbol	Units	PS6-38	PS6-12	PS6-58	PS6-34	PS6-1
Sį	pecified Tensile Strength	F _{uta}	psi (Mpa)	100, (69	,000 90)		85,000 (590)	
<u> </u>	Nominal Strength as Governed by	N _{sa}	lb. (kN)	10,195 (45.3)	13,550 (60.3)	25,660 (114.1)	32,710 (145.5)	66,760 (297.0)
ess Str (PS6)	Steel Strength	V _{sa}	lb. (kN)	6,115 (27.2)	8,130 (36.2)	15,395 (68.5)	19,625 (87.3)	40,055 (178.2)
316 Stainless Steel Inserts (PS6)	Strength Reduction Factor for Tension ⁴	φ				0.65		·
316	Strength Reduction Factor for Shear ⁴	φ				0.60		

^{1.} Values provided for common rod material types are based on specified strength and calculated in accordance with ACI 318-14 Eq. 17.4.1.2 and Eq. 17.5.1.2b or ACI 318-11 Eq. (D-2) and Eq. (D-29), as applicable. Nuts and washers shall be appropriate for the rod strength and type.

^{2.} Cross-sectional area is minimum stress area applicable for either tension or shear.

^{3.} For use with load combinations of IBC Section 1605.2, ACI 318-14 5.3 or ACI 318-11 9.2, as applicable, as set forth in ACI 318-14 17.3.3 or ACI 318-11 D.4.3. If the load combinations of ACI 318-11 Appendix C are used, the appropriate value of *φ* shall be determined in accordance with ACI 318-11 D4.4. Values correspond to a ductile steel element.

^{4.} For use with load combinations of IBC Section 1605.2, ACI 318-14 5.3 or ACI 318-11 9.2, as applicable, as set forth in ACI 318-14 17.3.3 or ACI 318-11 D.4.3. If the load combinations of ACI 318-11 Appendix C are used, the appropriate value of φ shall be determined in accordance with ACI 318-11 D4.4. Values correspond to a brittle steel element.



Technical Data



TABLE 17: ULTRABOND HS-1CC CONCRETE BREAKOUT design information for POWER-SERT INTERNALLY THREADED INSERTS

Design Information	Symbol	Units	PS2-38 PS6-38	PS2-12 PS6-12	PS2-58 PS6-58	PS2-34 PS6-34	PS2-1 PS6-1
Internal Thread Size (UNC)	d_t	inTPI	3/8 - 16	1/2-13	5/8 - 11	3/4 - 10	1 - 8
Nominal Anchor Diameter	d _a	in. (mm)	0.488 (12.4)	0.595 (15.1)	0.819 (20.8)	0.898 (22.8)	1.450 (36.8)
Effective Embedment depth for Concrete Breakout	h _{ef}	in. (mm)	2.5 (64)	3.5 (89)	5.5 (140)	6.2 (157)	8.2 (208)
Minimum Nominal Embedment Depth	h _a	in. (mm)	2 3/4 (70)	3 11/16 (94)	5 3/4 (146)	6 1/2 (165)	8 1/2 (216)
Effectiveness Factor for Uncracked Concrete	K _{c,uncr}	Inlb. SI			24 (10)		
Minimum Spacing Distance	S _{min}	in. (mm)			$S_{min} = C_{min}$		
Minimum Edge Distance	C _{min}	in. (mm)	2 1/2 (64)	3 1/8 (79)	4 3/8 (111)	5 (127)	7 1/2 (191)
Minimum Concrete Thickness	h _{min}	in. (mm)	4 1/2 (114)	5 3/8 (137)	8 (203)	9 1/2 (241)	12 1/2 (318)
Critical Edge Distance	C _{ac}	in.				$\max \left[\left(3.1 - 0. \right. \right.$. =
(Uncracked Concrete Only)	o ac	mm	$C_{ac} = h_{e_f}$	$\cdot \left(\frac{\min(\tau_{k,uncr})}{8}\right)$	$\left(\frac{\tau_{k,\mathrm{max}}}{2}\right)^{0.4}$	$\max \left[\left(3.1 - 0. \right) \right]$	$7\frac{h}{h_{ef}}$;1.4
Strength Reduction Factor for Tension, Concrete Failure Mode, Condition B ¹	φ				0.65		
Strength Reduction Factor for Shear, Concrete Failure Mode, Condition B ¹	φ				0.70		

For **SI**: 1 inch = 25.4 mm, 1lbf = 4.448 N, 1 psi = 0.006897 MPa

^{1.} Values provided for post-installed anchors with category as determined from ACI 355.4 given for Condition B. Condition B applies without supplementary reinforcement or where pullout (bond) or pryout govern, as set forth in ACI 318-14 17.3.3 or ACI 318-11 D.4.3, as applicable, while condition A requires supplemental reinforcement. Values are for use with the load combinations Section 1605.2 of the IBC, ACI 318-14 5.3 or ACI 318-11 Section 9.2, as applicable, as set forth in ACI 318-11 D.4.3. If the load combinations of ACI 318-11 Appendix C are used, the appropriate value of ϕ must be determined in accordance with ACI 318-11 D.4.4.



Technical Data



TABLE 18: ULTRABOND HS-1CC **BOND STRENGTH** design information for **POWER-SERT INTERNALLY THREADED INSERT** in holes drilled with a **HAMMER DRILL** and **CARBIDE BIT** - Maximum Long Term Service Temperature 110 °F (43 °C)^{1,2,3,4}

		Design Information		Symbol	Units	PS2-38 PS6-38	PS2-12 PS6-12	PS2-58 PS6-58	PS2-34 PS6-34	PS2-1 PS6-1
l	Int	ternal Thread Size (UN	IC)	d _t	inTPI	3/8 - 16	1/2 - 13	5/8 - 11	3/4 - 10	1 - 8
		Anchor Diameter		d _a	in.	0.488	0.595	0.819	0.898	1.450
		Drill Bit Diameter		d _o	in.—TPI 3/8 - 16 1/2 - 13 5/8 - 11 3/4 - 10 in. 0.488 0.595 0.819 0.898 in. 1/2 5/8 7/8 1 in. 3 1/4 4 1/8 6 1/4 7 1/2 (mm) (83) (105) (159) (191) in. 2 3/4 3 11/16 5 3/4 6 1/2 (mm) (70) (94) (146) (165) in. 1.55 2.49 3.75 3.74 (mm) (39) (63) (95) (95) psi 2,410 2,325 2,150 2,090 (MPa) (16.6) (16.0) (14.8) (14.4) psi 2,765 2,670 2,470 2,400 (MPa) (19.1) (18.4) (17.0) (16.5) psi 2,120 2,045 1,895 1,840 (MPa) (14.6) (14.1) (13.1) (12.7) (12.7) psi 2,435 2,350 2,175 2,110 (MPa) (16.8) (16.2) (15.0) (14.5) psi (MPa) (6.2) (6.0) (5.6) (5.4) psi (MPa) (6.2) (6.0) (5.6) (5.4) psi 1,035 1,000 925 900 (MPa) (7.1) (6.9) (6.4) (6.2)			1 1/2		
	R	ecommended Drill Dep	oth	h _{drill}				0.595 0.819 0.898 5/8 7/8 1 4 1/8 6 1/4 7 1/2 (105) (159) (191) 3 11/16 5 3/4 6 1/2 (94) (146) (165) 2.49 3.75 3.74 (63) (95) (95) 2,325 2,150 2,090 (16.0) (14.8) (14.4) 2,670 2,470 2,400 (18.4) (17.0) (16.5) 2,045 1,895 1,840 (14.1) (13.1) (12.7) 2,350 2,175 2,110 (16.2) (15.0) (14.5) 870 805 785 (6.0) (5.6) (5.4) 1,000 925 900 (6.9) (6.4) (6.2)		
		Overall Anchor Length	1	h _a		l		8-13 5/8 - 11 3/4 - 10 595 0.819 0.898 5/8 7/8 1 1 1/8 6 1/4 7 1/2 9 05) (159) (191) 1/16 5 3/4 6 1/2 8 94) (146) (165) 3.74 63) (95) (95) 325 2,150 2,090 6.0) (14.8) (14.4) 670 2,470 2,400 6.84 (17.0) (16.5) 6.2 045 1,895 1,840 4.1) (13.1) (12.7) 3350 2,175 2,110 6.2) (15.0) (14.5) 70 70 805 785 6.0) (5.6) (5.4) 6.9 6.9 6.4) (6.2) 0.00 925 900 6.4) (6.2) 0.65		8 1/2 (216)
	Bond	Effective Embedment	Depth	h _{ef}		l		695 0.819 0.898 1 6/8 7/8 1 1 1/8 6 1/4 7 1/2 9 05) (159) (191) (0 1/16 5 3/4 6 1/2 8 44) (146) (165) (0 49 3.75 3.74 9 (3) (95) (95) (0 25 2,150 2,090 1 3.0) (14.8) (14.4) (1 3.4) (17.0) (16.5) (1 445 1,895 1,840 1 4.1) (13.1) (12.7) (1 (50 2,175 2,110 1 3.2) (15.0) (14.5) (6 0.0 (5.6) (5.4) (6 0.0 (5.6) (5.4) (6 0.9) (6.4) (6.2) (6		
	um Short Term	Uncracked Concrete Characteristic	With Sustained Load	τ	'	· '	,	5/8 7/8 1 1 1/8 6 1/4 7 1/2 9 05) (159) (191) (2 1/16 5 3/4 6 1/2 8 04) (146) (165) (2 49 3.75 3.74 5 63) (95) (95) (1 30.0 (14.8) (14.4) (1 370 2,470 2,400 1, 3.4) (17.0) (16.5) (1 44.1) (13.1) (12.7) (1 380 2,175 2,110 1, 3.2) (15.0) (14.5) (1 70 805 785 6 3.0) (5.6) (5.4) (6 0.0 925 900 7 3.9) (6.4) (6.2) (6		
	g Temperature 0 ° F (66 °C)	Bond Strength	No Sustained Load	${\cal T}_{k,uncr}$		· '		633 (95) (95) (1 325 2,150 2,090 1, 6.0) (14.8) (14.4) (1 670 2,470 2,400 1, 8.4) (17.0) (16.5) (1 045 1,895 1,840 1, 4.1) (13.1) (12.7) (1 350 2,175 2,110 1, 6.2) (15.0) (14.5) (1 70 805 785 6 6.0) (5.6) (5.4) (**		
	um Short Term	Uncracked Concrete	With Sustained Load	-T		· '		(18.4) (17.0) (16.5) (1 2,045 1,895 1,840 1,4 (14.1) (13.1) (12.7) (1 2,350 2,175 2,110 1,6		
	g Temperature 0 ° F (82 °C)	Characteristic Bond Strength	No Sustained Load	${\cal T}_{k,uncr}$		· '	2,045 1,895 1,840 1, (14.1) (13.1) (12.7) (7 2,350 2,175 2,110 1, (16.2) (15.0) (14.5) (7			1,675 (11.5)
	um Short Term	Uncracked Concrete	With Sustained Load	_						620 (4.3)
	g Temperature 5 ° F (96 °C)	Characteristic Bond Strength	No Sustained Load	T _{k,uncr}						715 (4.9)
Continuous Inspection	U	duction Factors for ble Installation	Dry Concrete	ф d				0.65		
Contir Inspe		ditions ^{5,6,7}	Water Saturated Concrete	φ _{ws}		0.65	5 0.55			
Periodic Inspection	Strength Reduction Factors for Permissible Installation		Dry Concrete	ф d				0.65		
Perio Inspe		ditions ^{5,6,7}	Water Saturated Concrete	φ _{ws}		0.55 0.45				

For SI: 1 inch = 25.4 mm, 1 lbf = 4.448 N, 1 psi = 0.006897 MPa

- 1. Characteristic bond strength values correspond to concrete compressive strength f'_c =2,500 psi (17.2 MPa). For uncracked concrete compressive strength f'_c between
- 2,500 psi (17.2 MPa) and 8,000 psi (55.2 MPa), the tabulated characteristic bond strength may be increased by a factor of (f' c /2,500)^{0.1} (for SI: (f' c /17.2)^{0.1}).
- 2. Lightweight concrete may be used by applying a reduction factor as given in ACI 318-14 17.2.6 or ACI 318-11 Appendix D section D3.6 as applicable.
- 3. Short term elevated concrete temperatures are those that occur over brief intervals, e.g., as a results of diurnal cycling. Long term concrete temperatures are roughly constant over significant periods of time.
- 4. Characteristic bond strength values are for sustained loads (when noted), including dead and live loads.
- 5. The tabulated value of ϕ applies when load combinations of Section 1605.2 of the IBC or ACI 318-14 5.3 (ACI 318-11 9.2), are used in accordance with ACI 318-14 17.3.3 (ACI 318-11 D.4.3). If the load combinations of ACI 318-11 Appendix C are used, the appropriate value of ϕ shall be determined in accordance with ACI 318 D.4.4.
- 6. The values of ϕ correspond to Condition B as described in ACI 318-14 17.3.3 (ACI 318-11 D.4.3) for post-installed anchors designed using the load combinations of IBC Section 1605.2. If the load combinations in ACI 318-11 Appendix C are used, the corresponding value of ϕ shall be determined.
- 7. The values of φ correspond to the anchor category as set forth in ACI 318-14 17.3.3 (ACI 318-11 D.4.3). The φ factor of 0.65 represents a Category 1, 0.55 a Category 2 and 0.45 a Category 3.



Technical Data



TABLE 19: ULTRABOND HS-1CC allowable **TENSION** loads for **THREADED ROD**, in holes drilled with a **HAMMER DRILL**, in normal-weight concrete¹

Threaded Rod	Nominal Drill Bit		dment		n Load Based on oncrete Capacity ^{2,3} (kN)	А	llowable		on Load trength⁴	Based o	n
Diameter in.	Diameter in.		mm)	f' _c ≥ 2,500 ps	si (17.4 MPa)	Grad	F1554 de 36 (kN)	_	l A193 le B7 (kN)	304/3	l F593 16 SS (kN)
		2 3/8	(60)	1,681	(7.5)						
3/8	7/16	3 3/8	(86)	2,655	(11.8)	2.114	(9.4)	4.556	(20.3)	3,645	(16.2)
3/6	7/10	4 1/2	(114)	3,858	(17.2)	2,114	(9.4)	4,550	(20.3)	3,045	(10.2)
		7 1/2	(191)	7,838	(34.9)						
		2 3/4	(70)	2,282	(10.2)						
1/2	9/16	4 1/2	(114)	4,329	(19.3)	3,758	(16.7)	8,099	(36.0)	6,480	(28.8)
1/2	9/10	6	(152)	6,292	(28.0)	3,730	(10.7)	0,099	(30.0)	0,400	(20.0)
		10	(254)	12,266	(54.6)						
		3 1/8	(79)	2,911	(13.0)						
5/8	3/4	5 5/8	(143)	6,326	(28.1)	5.872	(26.1)	12,655	(56.3)	10,124	(45.0)
5/6	3/4	7 1/2	(191)	9,195	(40.9)	3,072	(20.1)	12,055	(30.3)	10,124	(45.0)
		12 1/2	(318)	17,863	(79.5)						
		3 1/2	(86)	3,451	(13.7)						
3/4	7/8	6 3/4	(171)	8,625	(38.4)	8.456	(37.6)	18,224	(81.1)	12,392	(55.1)
3/4	176	9	(229)	12,536	(55.8)	0,430	(37.0)	10,224	(01.1)	12,392	(55.1)
		15	(381)	24,354	(108.3)						
		3 3/4	(95)	3,827	(17.0)						
7/8	1	7 7/8	(200)	11,209	(49.9)	11.509	(51.2)	24 904	(110.3)	16 967	(75.0)
1/6	'	10 1/2	(267)	16,292	(72.5)	11,509	(31.2)	24,004	(110.3)	10,007	(75.0)
		17 1/2	(445)	31,650	(140.8)						
		4	(102)	4,216	(18.8)						
1	1 1/8	9	(229)	14,065	(62.6)	15,033	(66.9)	22 200	(144.1)	22 020	(98.0)
'	1 1/6	12	(305)	20,444	(90.9)	15,055	(00.9)	32,390	(144.1)	22,030	(90.0)
		20	(508)	39,716	(176.7)						
		5	(127)	5,892	(26.2)						
1 1/4	1 3/8	11 1/4	(286)	19,887	(88.5)	22 400	(104.5)	50 624	(225.2)	24 422	(152.1)
1 1/ 4	1 3/0	15	(381)	29,875	(132.9)	23,408	(104.5)	30,021	(225.2)	34,423	(155.1)
		25	(635)	58,038	(258.2)						

For **SI**: 1 inch = 25.4 mm, 1lbf = 4.448 N, 1 psi = 0.006897 MPa.

^{1.} The lower value of either the allowable bond strength/concrete capacity or steel strength should be used as the allowable tension value for design.

^{2.} Allowable tension loads calculated based on strength design provisions of IBC Section 1605.3 with the following assumptions: Maximum short term temperature = 150 °F (66 °C), Maximum long term temperature = 110 °F (43 °C). Load combination from ACI based on 1.2D + 1.6L assuming dead load of 0.3 and live load of 0.7 giving a weighted average of 1.48. $f_c = 2,500$ psi normal-weight uncracked concrete. Single anchor, drilled with either hammer drill or carbide bit, vertically down with periodic special inspection and no seismic loading. $\phi_d = 0.65$ for dry concrete, $C_{a1} \ge 1.5 \times h_{ef}$, $h_{min} \ge 1.5 \times C_{a1}$, $C_{a2} \ge 1.5 \times C_{a1}$. Load values based on characteristic uncracked bond strength with sustained load.

^{3.} For short term temperature exposure greater than 150 °F (66 °C) and up to and including 180 °F (82 °C), apply a reduction factor of 0.88 to the allowable tension load. For short term temperature exposure greater than 180 °F (82 °C) and up to and including 205 °F (96 °C), apply a reduction factor of 0.375 to the allowable tension load.

^{4.} Allowable steel strengths calculated in accordance with AISC Manual of Steel Construction: Tensile = 0.33 * F_u * A_{nom}.



Technical Data



TABLE 20: ULTRABOND HS-1CC allowable **SHEAR** loads for **THREADED ROD**, in holes drilled with **HAMMER DRILL**, in normal-weight concrete¹

Threaded Rod	Nominal Drill Bit	Embe			r Load Based on oncrete Capacity ^{2,3} (kN)		Allowa		r Load Ba trength ⁴	ised on	
Diameter in.	Diameter in.	in. (ı	mm)	f' _c ≥ 2,500 ps	si (17.4 MPa)	ASTM Grac Ibs.	le 36	Grad	l A193 de B7 (kN)	ASTM 304/3 ² lbs.	16 SS
		2 3/8	(60)	1,608	(7.2)						
3/8	7/16	3 3/8	(86)	3,140	(14.0)	1.089	(4.8)	2.347	(10.4)	1.878	(8.4)
3/0	7/10	4 1/2	(114)	5,006	(22.3)	1,003	(4.0)	2,047	(10.4)	1,070	(0.4)
		7 1/2	(191)	11,272	(50.1)						
		2 3/4	(70)	2,401	(10.7)	_					
1/2	9/16	4 1/2	(114)	5,780	(25.7)	1,936	(8.6)	4,172	(18.6)	3,338	(14.8)
.,_	0, 10	6	(152)	9,152	(40.7)	1,936	(0.0)	',''-	(10.0)	0,000	(11.0)
		10	(254)	20,407	(90.8)						
		3 1/8	(79)	3,163	(14.1)						
5/8	3/4	5 5/8	(143)	9,071	(40.4)	3 025	(13.5)	6,519	(29.0)	5,216	(23.2)
0,0	0, .	7 1/2	(191)	14,349	(63.8)	3,025 (13	(10.0)	0,0.0	(20.0)	0,2.0	(20.2)
		12 1/2	(318)	31,958	(142.2)	3,025 (13					
		3 1/2	(86)	4,024	(13.7)	_					
3/4	7/8	6 3/4	(171)	12,832	(57.1)	4,356 (19	(19.4)	9,388	(41.8)	6,384	(28.4)
		9	(229)	20,286	(90.2)		(- /	-,	(-/	, , , , ,	(- /
		15	(381)	45,142	(200.8)						
		3 3/4	(95)	4,687	(20.8)						
7/8	1	7 7/8	(200)	16,205	(72.1)	5,929	(26.4)	12,778	(56.8)	8,689	(38.7)
		10 1/2	(267)	25,605	(113.9)		(- /	′ -	(/	,	(/
		17 1/2	(445)	56,946	(253.3)						
		4	(102)	5,255	(23.4)	4					
1	1 1/8	9	(229)	19,830	(88.2)	7,744 (34.	(34.4)	16,690	(74.2)	11,349	(50.5)
		12	(305)	31,323	(139.3)	ļ [*]	` /		` /	, ,	` ′
		20	(508)	69,631	(309.7)						
		5	(127)	7,374	(32.8)	4					
1 1/4	1 3/8	11 1/4	(286)	27,774	(123.5)	12,100	(53.8)	26,078	(116.0)	17,733	(78.9)
		15	(381)	43,852	(195.1)	•	` /		. /		` ′
		25	(635)	97,421	(433.4)						

For **SI**: 1 inch = 25.4 mm, 1lbf = 4.448 N, 1 psi = 0.006897 MPa.

^{1.} The lower value of either the allowable bond strength/concrete capacity or steel strength should be used as the allowable shear value for design.

^{2.} Allowable shear loads calculated based on strength design provisions of IBC Section 1605.3 with the following assumptions: Maximum short term temperature = 150 °F (66 °C), Maximum long term temperature = 110 °F (43 °C). Load combination from ACI based on 1.2D + 1.6L assuming dead load of 0.3 and live load of 0.7 giving a weighted average of 1.48. f_c = 2,500 psi normal-weight uncracked concrete. Single anchor, drilled with either hammer drill or carbide bit, vertically down with periodic special inspection and no seismic loading. ϕ_d = 0.65 for dry concrete, $C_{a1} \ge 1.5 \times C_{a1}$, $C_{a2} \ge 1.5 \times C_{a1}$. Load values based on characteristic uncracked bond strength with sustained load.

^{3.} For short term temperature exposure greater than 150 °F (66 °C) and up to and including 180 °F (82 °C), apply a reduction factor of 0.88 to the allowable tension load. For short term temperature exposure greater than 180 °F (82 °C) and up to and including 205 °F (96 °C), apply a reduction factor of 0.375 to the allowable tension load.

^{4.} Allowable steel strengths calculated in accordance with AISC Manual of Steel Construction: Shear = 0.17 * F_u * A_{nom}.



Technical Data



TABLE 21: ULTRABOND HS-1CC allowable **TENSION** loads for **REBAR**, in holes drilled with a **HAMMER DRILL**, in normal-weight concrete¹

Rebar	Nominal Drill Bit	Embe De		Allowable Tensio Bond Strength / Co lbs.	oncrete Capacity ^{2,3}	Allowa		n Load Ba trength⁴	sed on
Size	Diameter in.	in. (ı		f' _c ≥ 2,500 ps	i (17.4 MPa)	Grac	A615 le 60 (kN)	Grac	l A615 le 75 (kN)
		2 3/8	(60)	1,805	(8.0)				
#3	1/2	3 3/8	(86)	2,777	(12.4)	2.640	(11.7)	3,300	(14.7)
#5	1/2	4 1/2	(114)	3,150	(14.0)	2,040	(11.7)	3,300	(14.7)
		7 1/2	(191)	5,344	(23.8)				
		2 3/4	(70)	2,403	(10.7)				
#4	5/8	4 1/2	(114)	4,431	(19.7)	4,800	(21.4)	6,000	(26.7)
#4	5/6	6	(152)	5,071	(22.6)	4,000	(21.4)	0,000	(20.7)
l .		10	(254)	8,308	(37.0)	1			
		3 1/8	(79)	2,911	(13.0)				
#5	3/4	5 5/8	(143)	6,335	(28.2)	7 4 4 0	(22.4)	0.000	(44.4)
#5	3/4	7 1/2	(191)	7,314	(32.5)	7,440	(33.1)	9,300	(41.4)
l .		12 1/2	(318)	11,731	(52.2)	1			
		3 1/2	(89)	3,451	(15.4)				
410	7/8	6 3/4	(171)	8,449	(37.6)	10.500	(47.0)	40.000	(50.7)
#6	1/8	9	(229)	9,842	(43.8)	10,560	(47.0)	13,200	(58.7)
l .		15	(381)	15,591	(69.4)	1			
	ĺ	3 3/4	(95)	3,827	(17.0)				
	4 4/0	7 7/8	(200)	10,757	(47.8)	44.400	(0.4.4)	40.000	(00.4)
#7	1 1/8	10 1/2	(267)	12,632	(56.2)	14,400	(64.1)	18,000	(80.1)
		17 1/2	(445)	19,944	(88.7)	1			
	ĺ	4	(102)	4,216	(18.8)				
410	4 4/4	9	(229)	13,205	(58.7)	40.000	(0.4.0)	00.700	(405.4)
#8	1 1/4	12	(305)	15,642	(69.6)	18,960	(84.3)	23,700	(105.4)
l .		20	(508)	24,864	(110.6)	1			
		4 1/2	(114)	5,031	(22.4)				
40	4 0/0	10 1/8	(257)	15,782	(70.2)	04.000	(400.0)	20.000	(400.4)
#9	1 3/8	13 1/2	(343)	18,853	(83.9)	24,000	(106.8)	30,000	(133.4)
		22 1/2	(572)	30,175	(134.2)	1			
		5	(127)	5,892	(26.2)				
#10	1 1/2	11 1/4	(286)	18,395	(81.8)	20.400	(12E C)	20 100	(160 E)
#10	1 1/2	15	(381)	22,192	(98.7)	30,480 (13	(135.6)	38,100	(169.5)
		25	(635)	35,807	(159.3)	<u> </u>			

For SI: 1 inch = 25.4 mm, 1lbf = 4.448 N, 1 psi = 0.006897 MPa.

^{1.} The lower value of either the allowable bond strength/concrete capacity or steel strength should be used as the allowable tension value for design.

^{2.} Allowable tension loads calculated based on strength design provisions of IBC Section 1605.3 with the following assumptions: Maximum short term temperature = 150 °F (66 °C), Maximum long term temperature = 110 °F (43°C). Load combination from ACI based on 1.2D + 1.6L assuming dead load of 0.3 and live load of 0.7 giving a weighted average of 1.48. $f_c = 2,500$ psi normal-weight uncracked concrete. Single anchor, drilled with either hammer drill or carbide bit, vertically down with periodic special inspection and no seismic loading. $\phi_d = 0.65$ for dry concrete, $C_{a1} \ge 1.5 \times h_{ef}$, $h_{min} \ge 1.5 \times C_{a1}$, $C_{a2} \ge 1.5 \times C_{a1}$. Load values based on characteristic uncracked bond strength with sustained load.

^{3.} For short term temperature exposure greater than 150 °F (66 °C) and up to and including 180 °F (82 °C), apply a reduction factor of 0.88 to the allowable tension load. For short term temperature exposure greater than 180 °F (82 °C) and up to and including 205 °F (96 °C), apply a reduction factor of 0.375 to the allowable tension load.

^{4.} Allowable steel strengths calculated in accordance with AISC Manual of Steel Construction: Tensile = 0.33 * Fu * Anom.



Technical Data



TABLE 22: ULTRABOND HS-1CC allowable **SHEAR** loads for **REBAR**, in holes drilled with a **HAMMER DRILL**, in normal-weight concrete¹

Rebar	Nominal Drill Bit	Embe		Allowable Shear Bond Strength / Co lbs.		Allow		· Load Base trength ⁴	ed on
Size	Diameter in.	in. (i		f' _c ≥ 2,500 ps	si (17.4 MPa)	Grad	l A615 de 60 (kN)	60 Grad	
		2 3/8	(60)	1,608	(7.2)				
#3	1/2	3 3/8	(86)	3,140	(14.0)	1,683	(7.5)	1,870	(8.3)
#0	1/2	4 1/2	(114)	3,915	(17.4)	1,000	(7.5)	1,070	(0.0)
		7 1/2	(191)	5,290	(23.5)				
		2 3/4	(70)	2,401	(10.7)				
#4	5/8	4 1/2	(114)	5,780	(25.7)	3,060	(13.6)	3,400	(15.1)
π⊶	3/0	6	(152)	7,016	(31.2)] 3,000	(13.0)	3,400	(13.1)
		10	(254)	9,388	(41.8)				
		3 1/8	(79)	3,163	(14.1)				
#5	3/4	5 5/8	(143)	9,071	(40.4)	4,743	(21.1)	5,270	(23.4)
#3	3/4	7 1/2	(191)	10,776	(47.9)] 4,743	(21.1)	3,270	(23.4)
		12 1/2	(318)	14,400	(64.1)	1			
		3 1/2	(86)	4,024	(13.7)]			
#6	7/8	6 3/4	(171)	12,574	(55.9)	6,732	(29.9)	7,480	(33.3)
#0	170	9	(229)	14,908	(66.3)	0,732	(29.9)	7,400	(33.3)
		15	(381)	19,906	(88.5)				
		3 3/4	(95)	4,687	(20.8)				
#7	1 1/8	7 7/8	(200)	15,546	(69.1)	9,180	(40.0)	10 200	(AE A)
#1	1 1/0	10 1/2	(267)	18,423	(81.9)	9,100	(40.8)	10,200	(45.4)
		17 1/2	(445)	24,584	(109.4)	1			
		4	(102)	5,255	(23.4)				
#8	1 1/4	9	(229)	18,580	(82.6)	12.007	(E2 0)	12 420	(50.7)
#8	1 1/4	12	(305)	22,011	(97.9)	12,087	(53.8)	13,430	(59.7)
		20	(508)	29,359	(130.6)	1			
		4 1/2	(114)	6,285	(28.0)				
#0	4 2/0	10 1/8	(257)	21,655	(96.3)	45 200	(00.4)	47.000	(75.0)
#9	1 3/8	13 1/2	(343)	25,648	(114.1)	15,300 (68.	(68.1)	17,000	(75.6)
		22 1/2	(572)	34,197	(152.1)	1			
	Ì	5	(127)	7,374	(32.8)				
440	4 4/0	11 1/4	(286)	24,618	(109.5)	40.404	(00.4)	04.500	(00.0)
#10	1 1/2	15	(381)	29,151	(129.7)	19,431	(86.4)	21,590	(96.0)
		25	(635)	38,858	(172.8)	1		ĺ	

For **SI**: 1 inch = 25.4 mm, 1lbf = 4.448 N, 1 psi = 0.006897 MPa.

^{1.} The lower value of either the allowable bond strength/concrete capacity or steel strength should be used as the allowable shear value for design.

^{2.} Allowable shear loads calculated based on strength design provisions of IBC Section 1605.3 with the following assumptions: Maximum short term temperature = 150 °F (66 °C), Maximum long term temperature = 110 °F (43 °C). Load combination from ACI based on 1.2D + 1.6L assuming dead load of 0.3 and live load of 0.7 giving a weighted average of 1.48. $f_c = 2,500$ psi normal-weight uncracked concrete. Single anchor, drilled with either hammer drill or carbide bit, vertically down with periodic special inspection and no seismic loading. $\phi_d = 0.65$ for dry concrete, $C_{a1} \ge 1.5 \times C_{a1}$, $C_{a2} \ge 1.5 \times C_{a1}$. Load values based on characteristic uncracked bond strength with sustained load.

^{3.} For short term temperature exposure greater than 150 °F (66 °C) and up to and including 180 °F (82 °C), apply a reduction factor of 0.88 to the allowable tension load. For short term temperature exposure greater than 180 °F (82 °C) and up to and including 205 °F (96 °C), apply a reduction factor of 0.375 to the allowable tension load.

^{4.} Allowable steel strengths calculated in accordance with AISC Manual of Steel Construction: Shear = 0.17 * F_u * A_{nom}.

ULTRABOND® HS-1CC Adhesive Anchor Installation Instructions


Installation Instructions

Drilling and Cleaning - Hammer Drilled Holes




- Using a rotary hammer drill & properly connected hollow vacuum bit system, ensure vacuum is on and drill hole to specified diameter and depth. No other cleaning is necessary - go to step 8.
- If a rotary hammer drill and standard carbide bit is used, drill hole to specified diameter and depth, go to step 2. For submerged conditions, skip to step 5.
- Remove standing water and blow out hole 2 cycles (2X) using oil free compressed air.
- Brush for 2 cycles (2X) in up/down twisting motion.
- Repeat step 2, then go to step 8.

Submerged Holes



- Flush hole with pressurized water until water flowing from hole is clean and free of debris
- Brush for 2 cycles (2X) in up/down twisting motion.
- Repeat step 5, then go to step 8.

Drilling and Cleaning - Core Drilled Holes



- Using a core drill bit, drill hole to specified diameter and depth and remove the core
- Flush hole with pressurized water until water flowing from hole is clean and free of debris.
- Remove standing water & blow out hole two cycles (2X) using oil free compressed air.
- Brush for 2 cycles (2X) in up/down twisting motion
- Repeat step 3, then go to step 8.

Dispensing Preparation - Cartridge Systems FOR CARTRIDGE SYSTEMS ONLY





(When using two-component bulk product skip to step 8 for BULK SYSTEMS)

- Remove protective cap, insert cartridge into recommended dispensing tool and balance until both components come out evenly.
- Screw on proper, non-modified ATC mixing nozzle to cartridge.

 Dispense and waste enough material to ensure uniform gray color before injecting into hole. For a new cartridge (or if working time has been exceeded), ensure cartridge opening is clean, install new nozzle and repeat steps 8 & 9. Go to step 13a

Dispensing Preparation - Bulk Systems FOR BULK SYSTEMS ONLY













- Epoxy materials may separate. This is normal and may be expected when stored over a period of time. Part A (Resin) should not be remixed. Part B (Hardener) should be remixed with a clean 5 gallon paint stick in a "butter churning" motion to homogenize the product.
- Pour Resin into Side A pump reservoir then close lid on Side A. Only after separately mixing Part B, pour hardener into Side B reservoir then close lid on Side B. Follow bulk pump instructions for filling the metering pump and outlet assembly, then bleed the air from the system and fill the hose and applicator.
- Balance the bulk pump machine following instructions in the Bulk Pump Operations Manual and test to ensure that it is dispensing the material on ratio (1:1). Screw on the proper, non-modified ATC mixing nozzle onto the bulk pump wand.
- Dispense and waste enough material to ensure uniform gray color before injecting into hole.

Installation and Curing



- 13a. Fill hole 2/3 full with adhesive starting at the bottom and withdraw as hole fills, using an extension tube as needed. Only fill hole 1/2 full when installing inserts.
- 13b. Use piston plugs for overhead and vertically inclined installations.
- 13c. If injecting in a water-filled hole, or underwater in a submerged condition, fill hole completely with adhesive as described in 13b.



- 14a. Fully insert clean threaded rod or rebar with slow turning motion to the bottom of the hole. For internally threaded inserts, thread a bolt into the insert and press it into the hole, finishing with hammer strikes until it is flush with the surface of the concrete.
- 14b. For horizontal, inclined or overhead installations, use wedges to support the anchor while curing
- Do not disturb, torque or apply load until full cure time has passed.

Reference Commentary

Drilling and Cleaning - Hammer Drilled Holes

Read and follow manufacturer's operations manual for the selected rotary drill.

R1a. Recommended hollow vacuum bit systems¹ for drilling dry & damp cracked and uncracked concrete. Drill bit should conform to ANSI B212.15. Once visual inspection confirms that hole is clean, proceed to step 8 for either Cartridge or Bulk Systems.

R1b. Traditional drilling method for drilling dry, water saturated and water-filled holes in cracked and uncracked concrete. Drill bit should conform to ANSI B212.15. **CAUTION:** Always wear appropriate personal protection equipment (PPE) for eyes, ears and skin to help avoid inhalation of dust during the drilling and cleaning process. Refer to the Safety Data Sheet (SDS) for details prior to proceeding

R2. BLOW (2X) - BRUSH (2X) - BLOW (2X). The compressed air wand should be inserted to the bottom of the hole, have a minimum pressure of 87 psi (6 bar) and be moved in an up/down motion to remove debris.

R3. Select the correct wire brush for the hole diameter, making sure it is long enough to reach the bottom of the drilled hole, using a brush extension if necessary. **CAUTION:** The brush should be clean and contact the walls of the hole. If it does not, the brush is either too worn or small and should be replaced with a new brush of the correct diameter.

R4. After final blow step is completed, visually inspect the hole to confirm it is clean. NOTE: If installation will be delayed for any reason, cover cleaned holes to prevent contamination. Proceed to step 8 for either Cartridge or Bulk Systems. R5. For submerged (underwater) installations, FLUSH – BRUSH (2X) – FLUSH. Start at the bottom or back of the hole

when flushing. R6. Select the correct wire brush for the hole diameter, making sure it is long enough to reach the bottom of the drilled hole, using a brush extension if necessary. **CAUTION:** The brush should be clean and contact the walls of the hole. If it does not, the brush is either too worn or small and should be replaced with a new brush of the correct diameter

R7. After final flush is completed, go to step 8 for either Cartridge or Bulk Systems ¹The Milwaukee 8-Gallon Dust Extractor vacuum-bit system is recommended by Adhesives Technology Corp.

Drilling and Cleaning - Core Drilled Holes

Read and follow manufacturer's operations manual for the selected core drill.

R1. Once hole is cored to the proper diameter and depth, remove center core and measure to ensure that specified embedment depth can be achieved. CAUTION: Always wear appropriate personal protection equipment (PPE) for eyes ears and skin to help avoid inhalation of dust during the drilling and cleaning process. Refer to the Safety Data Sheet (SDS) for details prior to proceeding.

R2. FLUSH – BLOW (2X) – BRUSH (2X) – BLOW (2X). Start at the bottom or back of the hole when flushing.

R3. The compressed air wand should be inserted to the bottom of the hole, have a minimum pressure of 87 psi (6 bar) and be moved in an up/down motion to remove debris.

R4. Select the correct wire brush for the hole diameter, making sure it is long enough to reach the bottom of the drilled hole, using a brush extension if necessary. CAUTION: The brush should be clean and contact the walls of the hole. If it does not, the brush is either too worn or small and should be replaced with a new brush of the correct diameter.

R5. After final blow step is completed, visually inspect the hole to confirm it is clean. NOTE: If installation will be delayed for any reason, cover cleaned holes to prevent contamination. Proceed to step 8 for either Cartridge or Bulk Systems

Dispensing Preparation - Cartridge Systems FOR CARTRIDGE SYSTEMS ONLY

R8. CAUTION: Check the expiration date on the cartridge to ensure it is not expired. Do not use expired product! Shelf life of ULTRABOND HS-1CC is 24 months when stored at temperatures between 40 °F (4 °C) and 95 °F (35 °C). Before attaching mixing nozzle, balance the cartridge by dispensing a small amount of material until both components are flowing evenly. For a cleaner environment, hand mix the two components and let cure prior to disposal in accordance with local regulations.

R9. Do not modify mixing nozzle and confirm that internal mixing element is in place prior to dispensing adhesive. Take note of the air and base material temperatures and review the working/full cure time chart prior to starting the injection process. R10. Test bead of mixed adhesive must be uniform in color and free of streaks, as adhesive must be properly mixed in order to perform as published. Dispose of the test bead according to federal, state and local regulations. CAUTION: When changing cartridges, never re-use nozzles and do not attempt to force adhesive out of a hardened mixing nozzle. Leave the mixing nozzle attached to the cartridge upon completion of work.

Dispensing Preparation - Bulk Systems FOR BULK SYSTEMS ONLY

The bulk pump uses a two-component delivery system whereby metering individual components and mixing of the two components are automatically controlled during dispensing through a metering manifold and disposable mixing nozzle. The bulk pump has a minimum input air pressure requirement of 80 - 90 psi @ 15 CFM, supplied through a regulator which reduces the pressure in order to control the rate of dispensing. The two individual adhesive components stay separate throughout the system, until they reach the specified disposable mixing nozzle via a manifold at the end of the bulk pump wand. Under normal operation, the bulk pump must be capable of dispensing the individual components at a 1:1 mix ratio by volume with a tolerance of + 2%

R8. CAUTION: Check the expiration dates on the bulk containers to ensure they are not expired. Do not use expired product! Shelf life of ULTRABOND HS-1CC is 24 months when stored at temperatures between 40 °F (4 °C) and 95 °F

(35 °C). Mix Part B carefully to avoid whipping air into product.

R9. NOTE: Review Bulk Pump Operations Manual thoroughly before proceeding and follow all steps necessary for set-up and operation of the pump. Fill each reservoir (hopper) to at least one-half full. Incoming air supply pressure should be maintained at approximately 100 psi (6.9 bar).

R10. Be sure to establish proper flow of both materials at the applicator tip prior to attaching mixing nozzle. A ratio check should always be performed before installation begins to confirm that equal volumes of Part A and Part B are being dispensed. This check must be completed prior to attaching the mixing nozzle.

R11. Do not modify mixing nozzle and confirm that internal mixing element is in place prior to dispensing adhesive. Take note of the air and base material temperatures and review the working/full cure time chart prior to starting the injection process R12. Test bead of mixed adhesive must be uniform in color and free of streaks, as adhesive must be properly mixed in order to perform as published. Dispose of the test bead according to federal, state and local regulations. CAUTION: Never re-use nozzles and do not attempt to force adhesive out of a hardened mixing nozzle.

Installation and Curing

NOTE: Building Code Requirements for Structural Concrete (ACI 318-14 and later) requires the Installer to be certified where adhesive anchors are to be installed in horizontal to vertically inclined (overhead) installations. The engineering drawings must be followed. For all applications not covered by this document, or for all installation questions, please contact Adhesives Technology Corp.

R13a. Be careful not to withdraw the mixing nozzle too quickly as this may trap air in the adhesive. Extension tubing can be connected as needed onto the outside of the tip of both the small mixing nozzle (T12) and the large mixing nozzle (T34HF). NOTE: When using a pneumatic dispensing tool, ensure that pressure is set at 90 psi (6.2 bar) maximum.

R13b. Select the proper piston plug for the drill hole diameter. The piston plug fits directly onto the tip of both the small and large mixing nozzle. Extension tubing may also be used if needed in order to reach the bottom of the drill hole.

R13c. Be careful not to withdraw the mixing nozzle assembly too quickly as this may trap water in the adhesive. The piston plug should push itself out of the hole from the pressure of the injected adhesive.

R14a. Prior to inserting the threaded rod or rebar into the hole, make sure it is straight, clean and free of oil/dirt and that the necessary embedment depth is marked on the anchor element. Insert the anchor elements into the hole while turning 1 - 2 rotations prior to the anchor reaching the bottom of the hole. Excess adhesive should be visible on all sides of the fully installed rod or rebar, but may not be visible on all sides of the insert. **CAUTION**: Use extra care with deep embedment or high temperature installations to ensure that the working time has not elapsed prior to the anchor being fully installed. Adjustments to the anchor alignment may only performed during the published working time for a given temperature. R14b. For overhead, horizontal and inclined (between horizontal and overhead), wedges should be used to support the anchor while the adhesive is curing. Take appropriate steps to protect the exposed threads of the anchor element from uncured adhesive until after the full cure time has elapsed

R15. The amount of time needed to reach full cure is base material dependent. Refer to the chart for appropriate full cure time for a given temperature

ULTRABOND® HS-1CC Adhesive Anchor Installation Instructions

INSTALLATION PARAMETERS FOR THREADED ROD AND REBAR

				Symbol Units Rebar Size #8 #9 #8 #9 #8 #9 #8 #9 #8 #9 #8 #9 #8 #9 #8 #9 #8 #9 #8 #9 #8 #9 #8 #9 #8 #9 #8 #9 #8 #9 #8 #9 #8 #9 #8 #9 #8 #9 #8 #9 #8 #9 #8 #9 #8 #9 #8 #9 #8 #9 #8 #9 #8 #9 #8 #9 #8 #9 #8 #9 #8 #9 #9								
	Characteris	tio	Cumbal	Unito	3/8	1/2	5/8	3/4	7/8	1	N/A	1 1/4
	Characteris	ouc	Syllibol	Units				Reba	ar Size			
					#3	#4	#5	#6	#7	#8	#9	#10
	Nominal And	hor Diameter	da	in.	0.375	0.500	0.625	0.750	0.875	1.000	N/A	1.250
l _	Drill	Size	d _o	in.	7/16	9/16	3/4	7/8	1	1 1/8	N/A	1 3/8
Rod	Brush	Part #			B716	B916	B34	B78	B100	B118	N/A	B138
P P	Piston Pl	ug Part#			PP716	PP916	PP34	PP78	PP100	PP118	N/A	PP138
ge	Piston Pl	ug Color			Black ¹	Blue	Yellow	Green	Black	Orange	N/A	Brown
hreade		A36/A307			10	25	50	90	125	165	NI/A	280
Ē	Maximum	Carbon Steel	<i>T</i>	Ft-lb	(14)	(34)	(68)	(122)	(169)	(224)	IN/A	(380)
l '	Tightening Torque	A193 B7 Carbon	I inst,max	(N-m)	16	33	60	105	125	165	NI/A	280
		Steel or F593 SS			(22)	(45)	(81)	(142)	(169)	(224)	IN/A	(380)
	Nominal Ba	r Diameter	da	in.	0.375	0.500	0.625	0.750	0.875	1.000	1.127	1.270
<u>#</u>	Drill	Size	d _o	in.	1/2	5/8	3/4	7/8	1	1 1/8	1 3/8	1 1/2
Rebar	Brush	Part #			B12	B58	B34	B78	B100 B118		B138	B112
Ř	Piston Pl	ug Part#			PP716	PP58	PP34	PP78	PP100	PP118	PP138	PP112
I	Piston Pl	ug Color			Black ¹	Red	Yellow	Green	reen Black Orange Brown			Gray
	Brush Leng	jth		i)				

Black nozzle adaptor with extension tubing for deep embedment depths in 7/16 and 1/2 inch hole diameters.

CONCRETE BREAKOUT DESIGN INFORMATION FOR THREADED ROD AND REBAR

					Т	hreaded Roc	l Diameter (ir	nch)		
Design Information	Comphal	Units	3/8	1/2	5/8	3/4	7/8	1	N/A	1 1/4
Design Information	Symbol	Units				Reb	ar Size			
			#3	#4	#5	#6	#7	#8	#9	#10
Minimum Embedment Depth	h _{ef.min}	in.	2 3/8	2 3/4	3 1/8	3 1/2	3 3/4	4	4 1/2	5
Millimum Embedment Depth	l lef,min	(mm)	(60)	(70)	(79)	(89)	(95)	(102)	(114)	(127)
Maximum Embedment Depth	h	in.	7 1/2	10	12 1/2	15	17 1/2	20	22 1/2	25
Maximum Embedment Depth	h _{ef,max}	(mm)	(191)	(254)	(318)	(381)	(445)	(508)	(572)	(635)
Minimum Spacing Diotopoo	0	in.	2 3/16	2 13/16	3 3/4	4 3/8	5	5 5/8	6 1/4	6 7/8
Minimum Spacing Distance	Smin	(mm)	(56)	(71)	(95)	(111)	(127)	(143)	(159)	(175)
Minimum Edge Distance	0.	in.	2 3/16	2 13/16	3 3/4	4 3/8	5	5 5/8	6 1/4	6 7/8
Willimum Eage Distance	Cmin	(mm)	(56)	(71)	(95)	(111)	(127)	(143)	(159)	(175)
Minimum Concrete Thickness	h .	in.	h _{ef} + 1.25	, [≥3.937]		h	+ 2do where	d is the hele	diameter	
Willimum Concrete Thickness	h _{min}	(mm)	(h _{ef} + 30	, [≥ 100])		116	#+ 200 Where	u _o is the note	ulametei	

For SI: 1 inch = 25.4 mm, 1 lbf = 4.448 N, 1 psi = 006894 MPa. For pound-inch units: 1 mm = 0.03937 inches, 1 N = 0.2248 lbf, 1 MPa = 145.0 psi.

CONCRETE BREAKOUT DESIGN INFORMATION AND INSTALLATION PARAMETERS FOR INTERNALLY THREADED INSERTS

Design Info	ormation or Characteristic	Symbol	Units	Internally Threaded Insert				
	Insert Part#			PS2-38 or PS6-38	PS2-12 or PS6-12	PS2-58 or PS6-58	PS2-34 or PS6-34	PS2-1 or PS6-1
Internal Thread Size (UNC)		dt	inTPI	3/8" - 16	1/2" - 13	5/8" - 11	3/4" - 10	1" - 8
Drill Size		d _o	in.	1/2	5/8	7/8	1	1 1/2
Nominal Anchor Diameter		da	in. (mm)	0.488 (12.4)	0.595 (15.1)	0.819 (20.8)	0.898 (22.8)	1.450 (36.8)
Minimum Nominal Embedment Depth		h _{ef,min}	in. (mm)	2 3/4 (70)	3 11/16 (94)	5 3/4 (146)	6 1/2 (165)	8 1/2 (216)
Minimum Spacing Distance		Cmin	in. (mm)	2 1/2 (64)	3 1/8 (79)	4 3/8 (111)	5 (127)	7 1/2 (191)
Minimum Edge Distance		C _{min}	in. (mm)	2 1/2 (64)	3 1/8 (79)	4 3/8 (111)	5 (127)	7 1/2 (191)
Minimum Concrete Thickness		h _{min}	in. (mm)	4 1/2 (114)	5 3/8 (137)	8 (203)	9 1/2 (241)	12 1/2 (318)
Maximum Tightening Torque	A36/A307 Carbon Steel	T _{inst,max}	Ft-lb	10 (14)	25 (34)	50 (68)	90 (122)	165 (224)
	A193 B7 Carbon Steel or F593 SS		(N-m)	16 (22)	33 (45)	60 (81)	105 (142)	165 (224)
Brush Part #				B12	B58	B78	B100	B112
Piston Plug Part #				PP12	PP58	PP78	PP100	PP112
Piston Plug Color				Black ¹	Red	Green	Black	Gray
Brush Length			in.	6 9				9

For SI: 1 inch = 25.4 mm, 1 lbf = 4.448 N, 1 psi = 006894 MPa. For pound-inch units: 1 mm = 0.03937 inches, 1 N = 0.2248 lbf, 1 MPa = 145.0 psi.

¹Black nozzle adaptor with extension tubing for deep embedment depths in 7/16 and 1/2 inch hole diameters.

CURE SCHEDULE^{1,2,3}

Base Material Temperature	Working Time	Full Cure Time	
°F (°C)	min	hr	
43 (6)	45	144	
50 (10)	35	72	
75 (24)	16	7	
90 (32)	12	4	
110 (43)	3	2	

Working and full cure times are approximate, may be linearly interpolated between listed temperatures and are based on cartridge/nozzle system performance.

Application Temperature: Substrate and ambient air temperature should be between 43 - 110 °F (6 - 43 °C). When ambient or base material temperature falls below 70 °F (21 °C), condition the adhesive to 70 - 75 °F (21 - 24 °C) prior to use. A high flow mixing nozzle (T34HF) may also

be used to ease dispensing at colder temperatures or to increase flow rate.

ADHESIVE DISPENSING TOOLS AND MIXING NOZZLES¹

D 1 0	8.6 fl.oz. (254 ml)	21.2 fl. oz. (627 ml)	53 fl. oz. (1.6 L)	10 Gallon (38 L) Kit		
Package Size	Cartridge	Cartridge	Cartridge	Resin	Hardener	
Part #	A9-HS1CC	A22-HS1CC	A53-HS1CC	B5G-HS1CC-A	B5G-HS1CC-B	
Manual Dispensing Tool	TM9HD	TM22HD		****		
Pneumatic Dispensing Tool		TA22HD-A	TA53HD-A	AST Pump Model Number RMP 6624-1717		
Battery Tool		TB22HD-A		****		
Recommended Mixing Nozzle	T12 or T34HF			T34HF		
SDS Brush Adaptor	BR-SDS					
Brush Extension	BR-EXT					
Nozzle Extension Tubing	TUBE916-EXT					
Retention Wedge	WEDGE					

¹Call for bulk packaging availability and lead times.

